

MEDIUM VOLTAGE AMP-TRAP FUSE

CAT. NO. A051B1DARO-19R
 A051B2DARO-32R
 A051B2DARO-38R
 A051B3DARO-48X
 A051B3DARO-57X


19R - 38R 5.5KV MAX
 48X & 57X 5.2KV MAX

PEAK LET-THRU DATA



Newburyport, MA 01950

102655

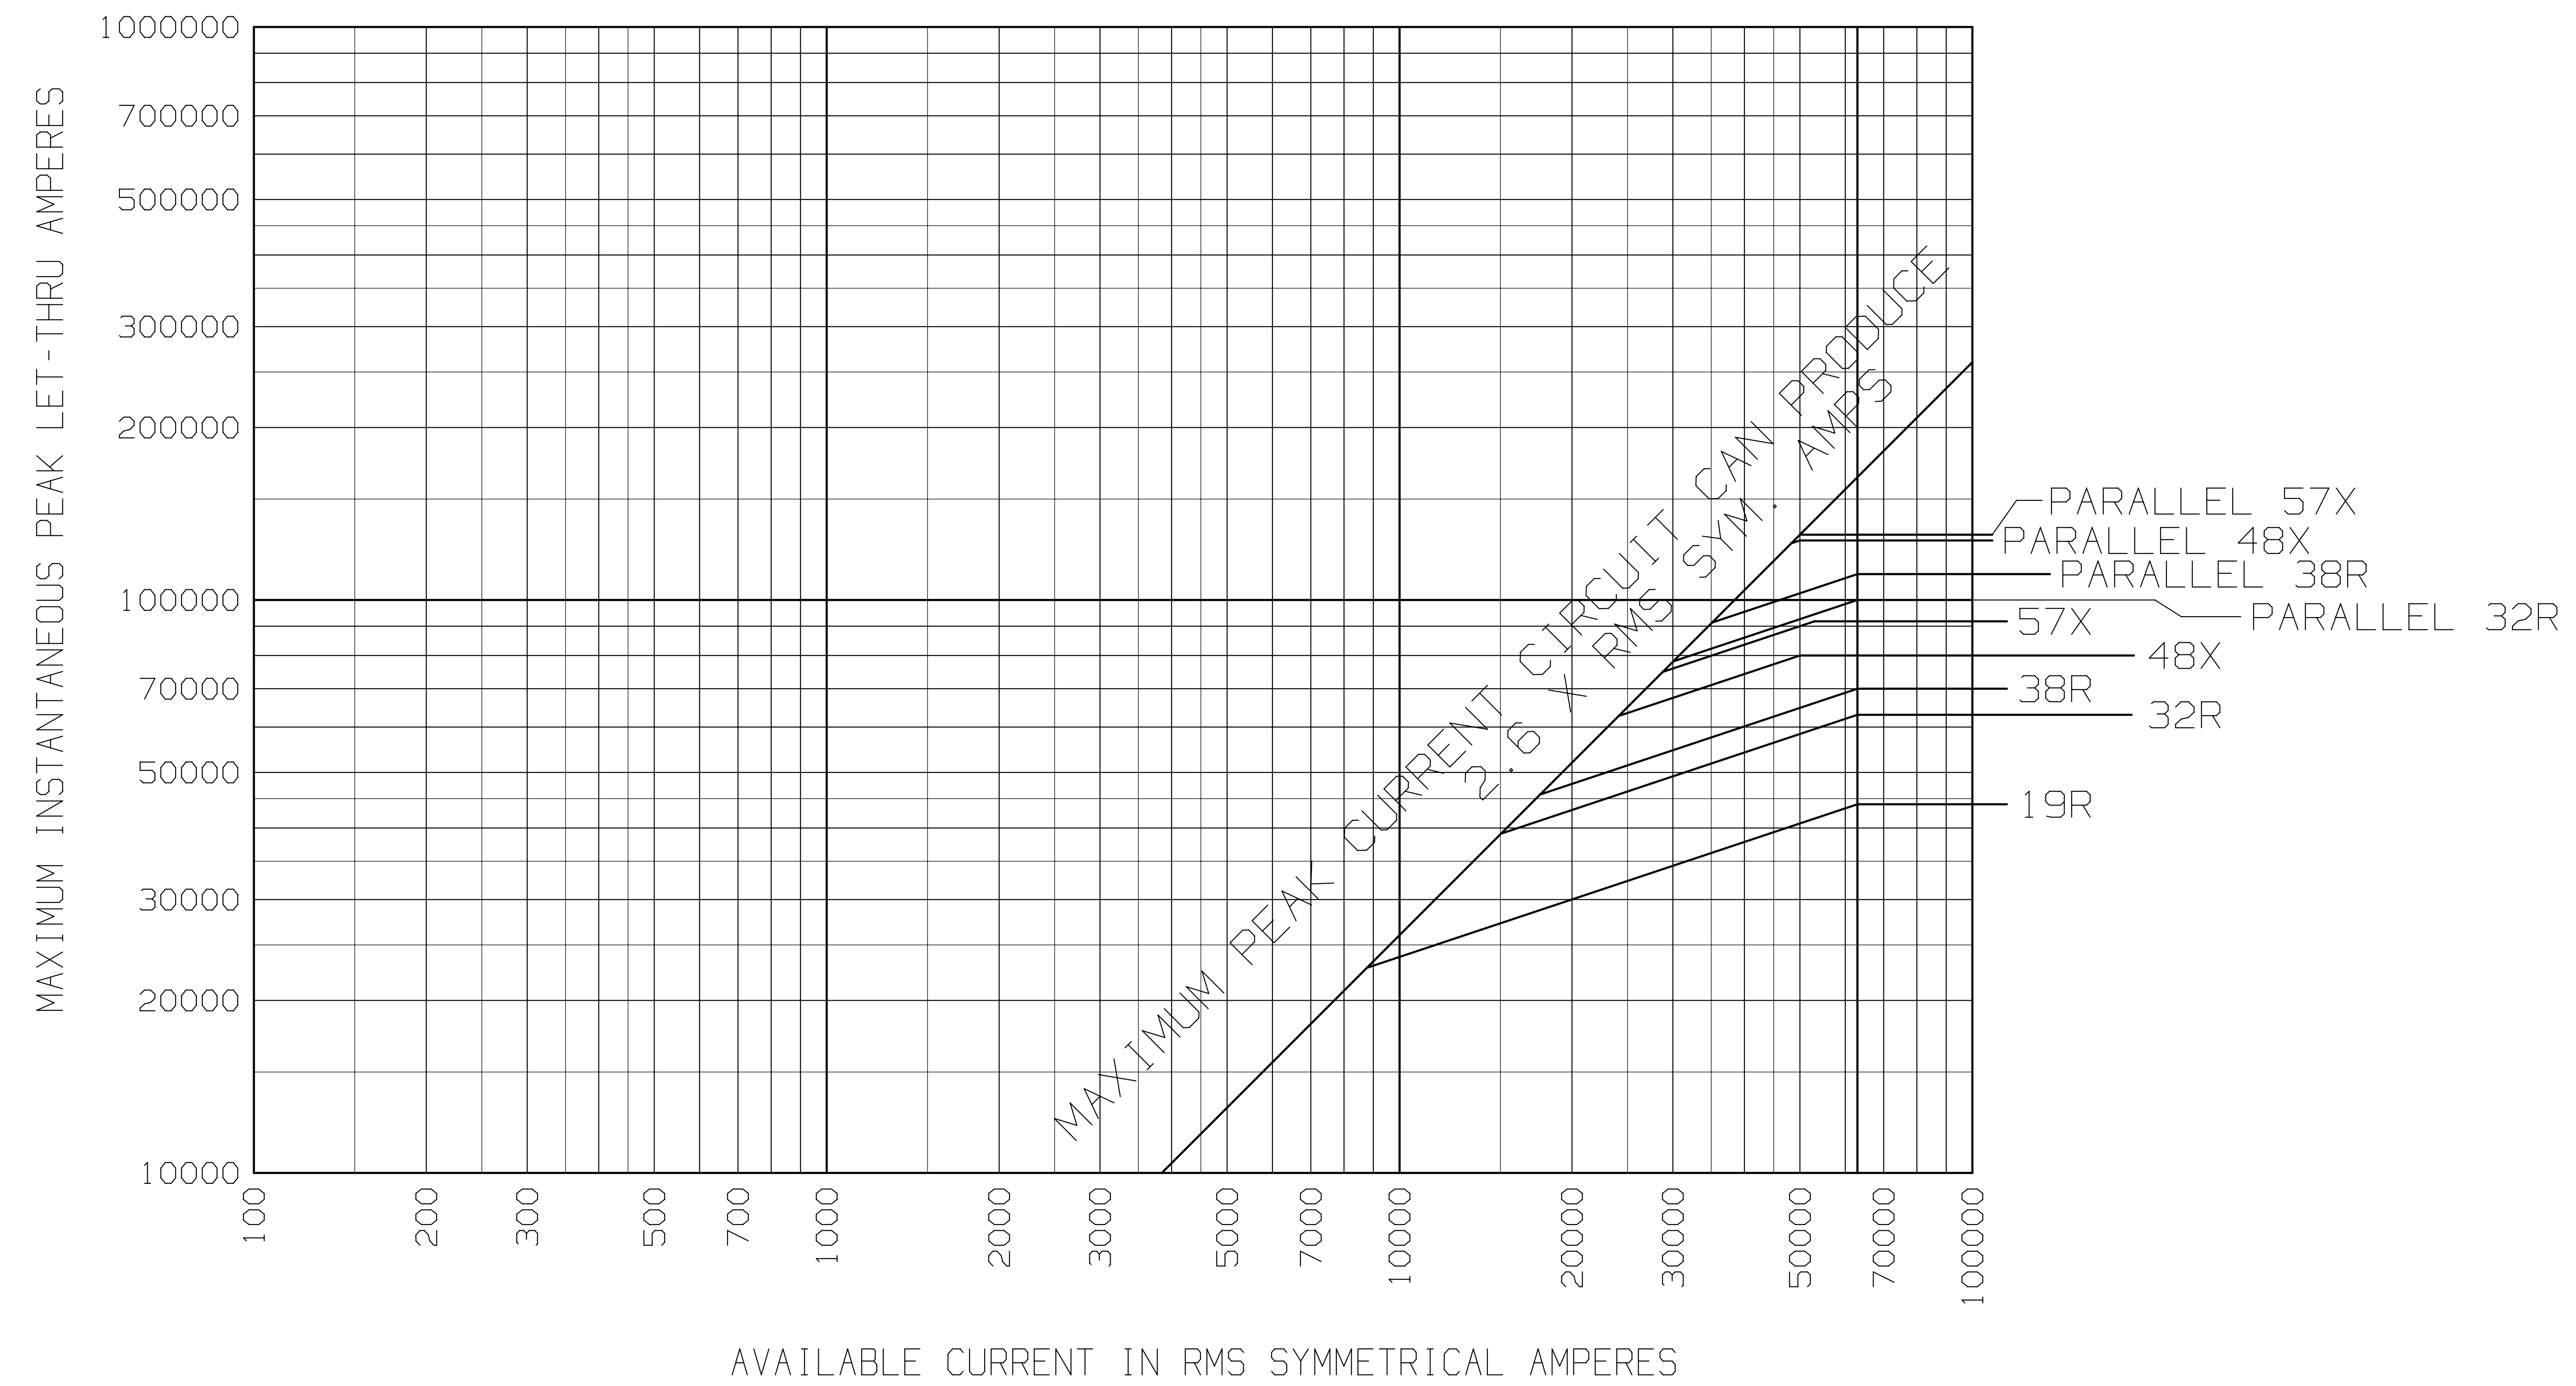

CONTROL NO: 569

REV. D
 5-17-04