



M30-63x Fused

Document no. 34M30-63F-A

M30-63x Fused

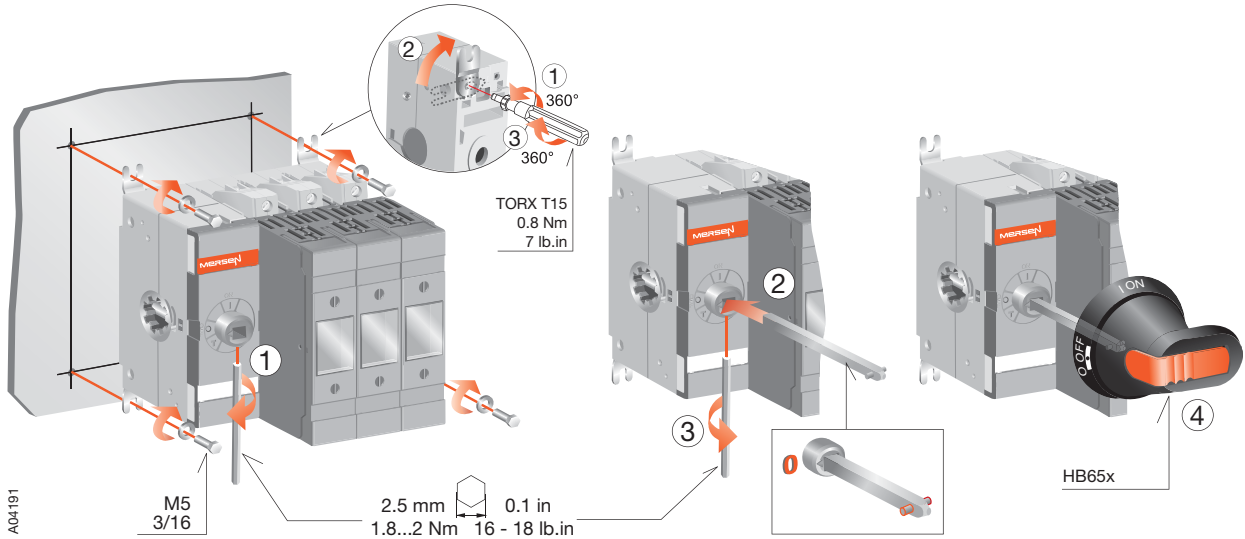


M30x - 63x

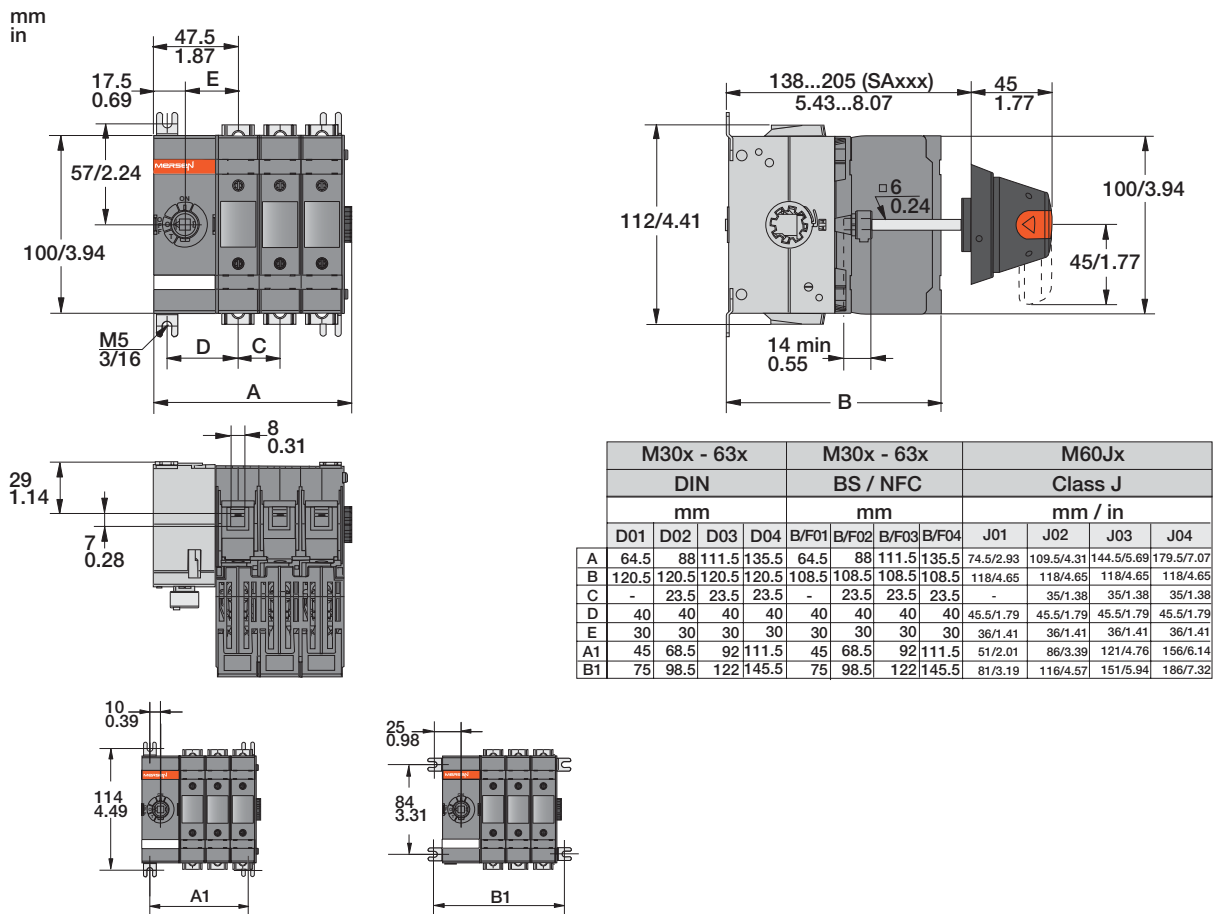


M30-63x Fused

1-2 configurations

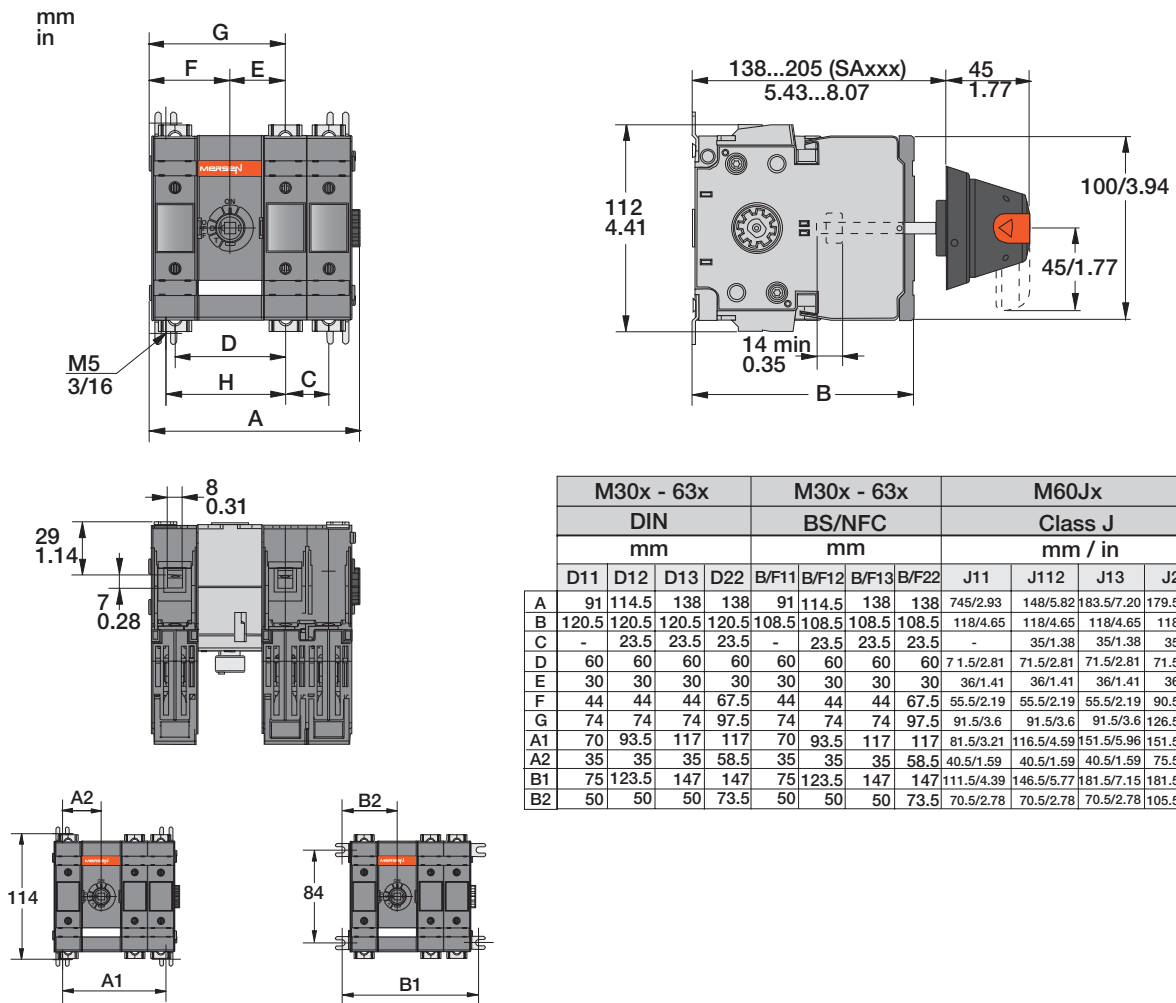




Clearances per UL98

Minimum enclosure size or equivalent volume

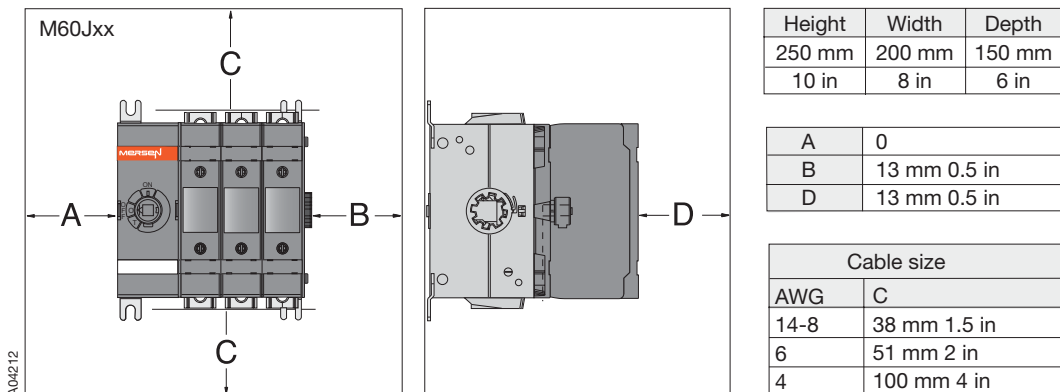


M30-63x Fused

LOFF160, LON160

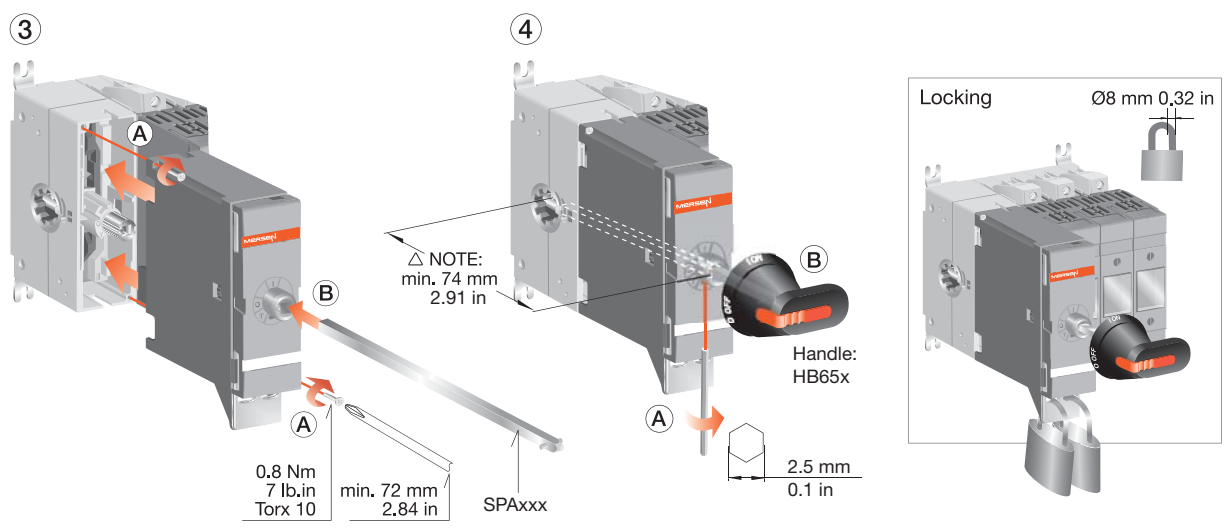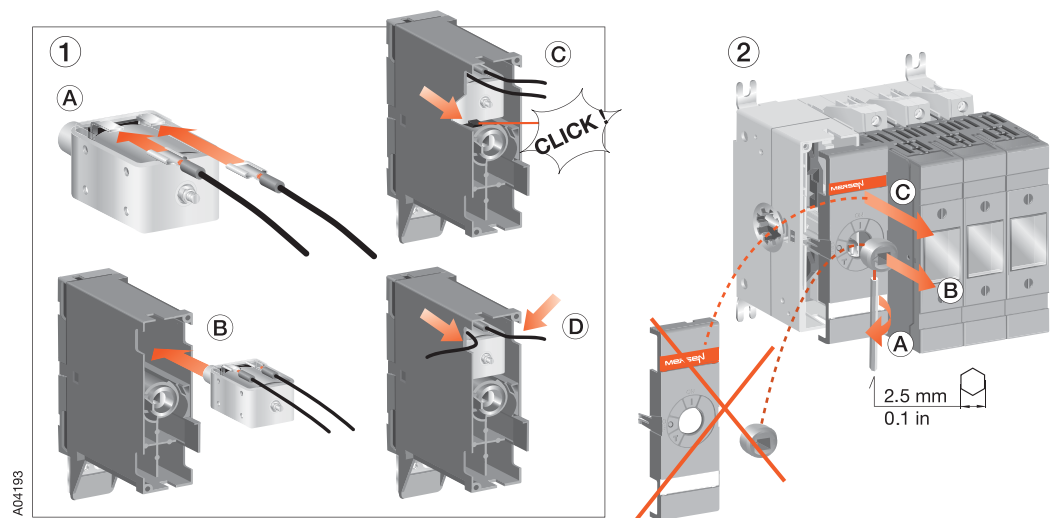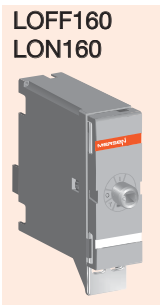


Label

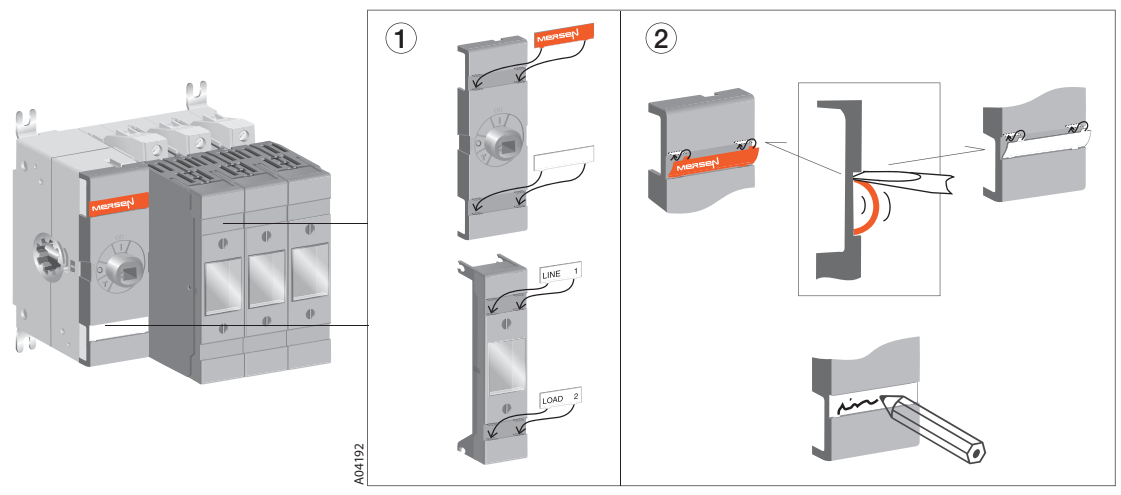


M30-63x Fused

Neutral links

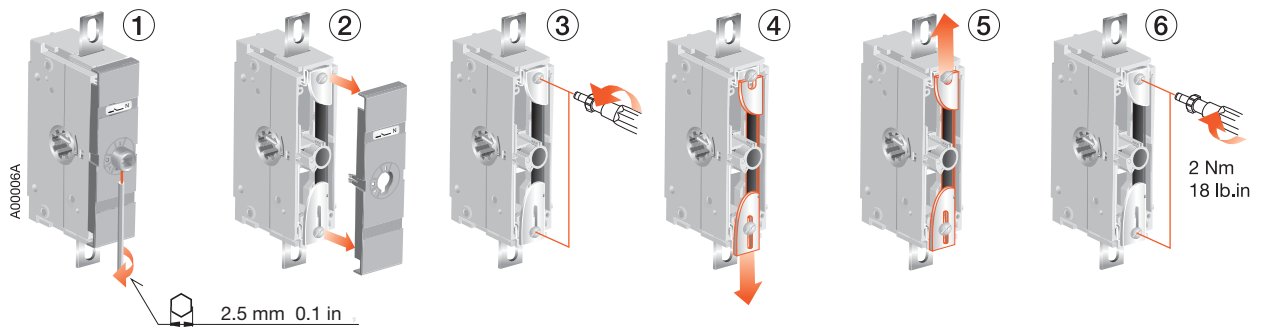


Cabling

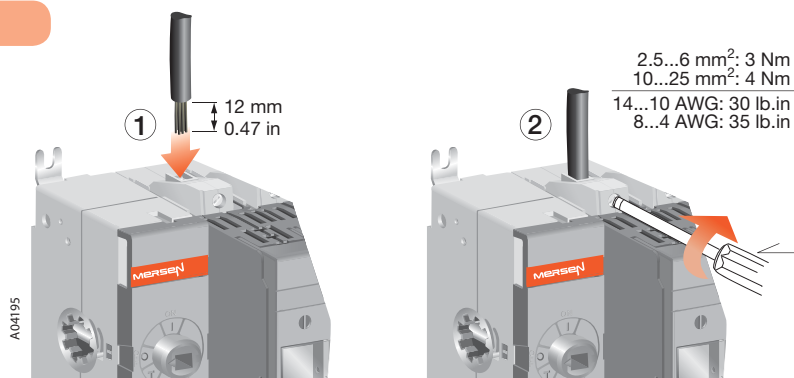


Fuse Monitor

Fuse Monitor +
M30x - M63x

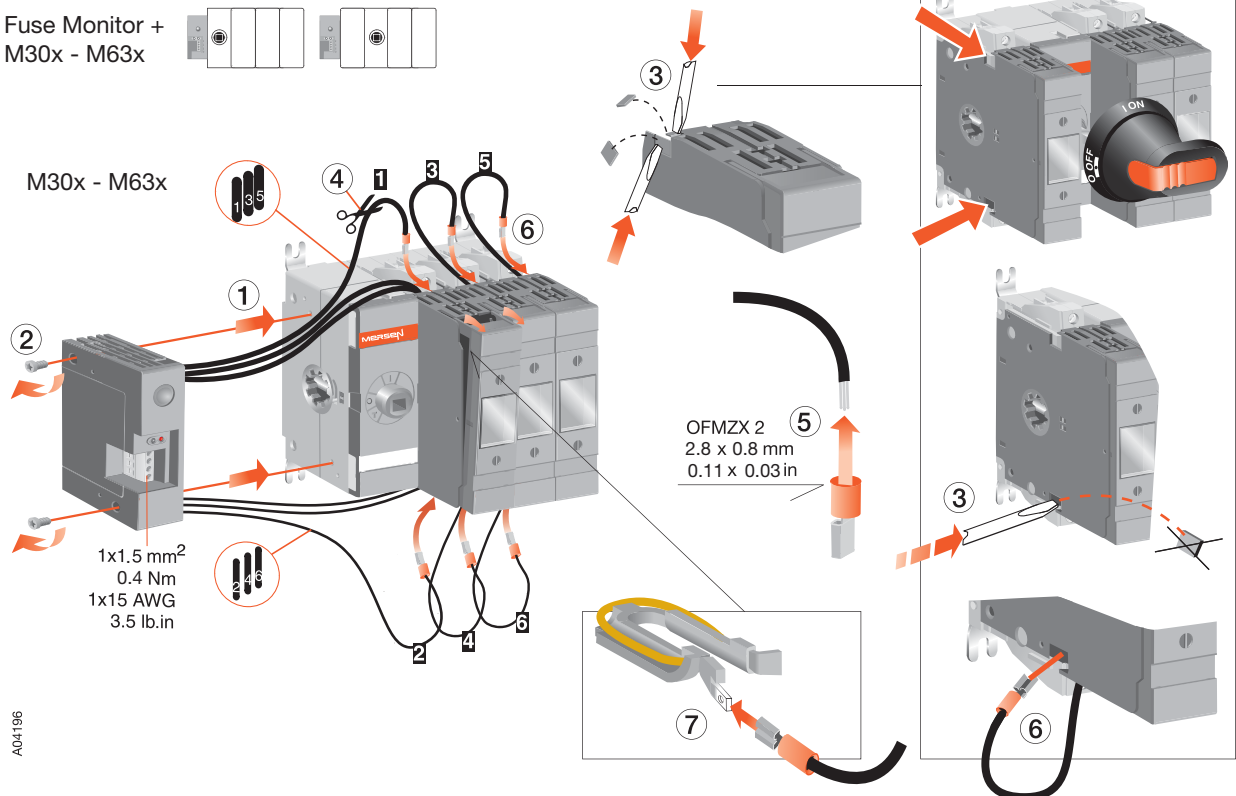


M30-63x Fused

Externally-mounted Auxiliary Contacts

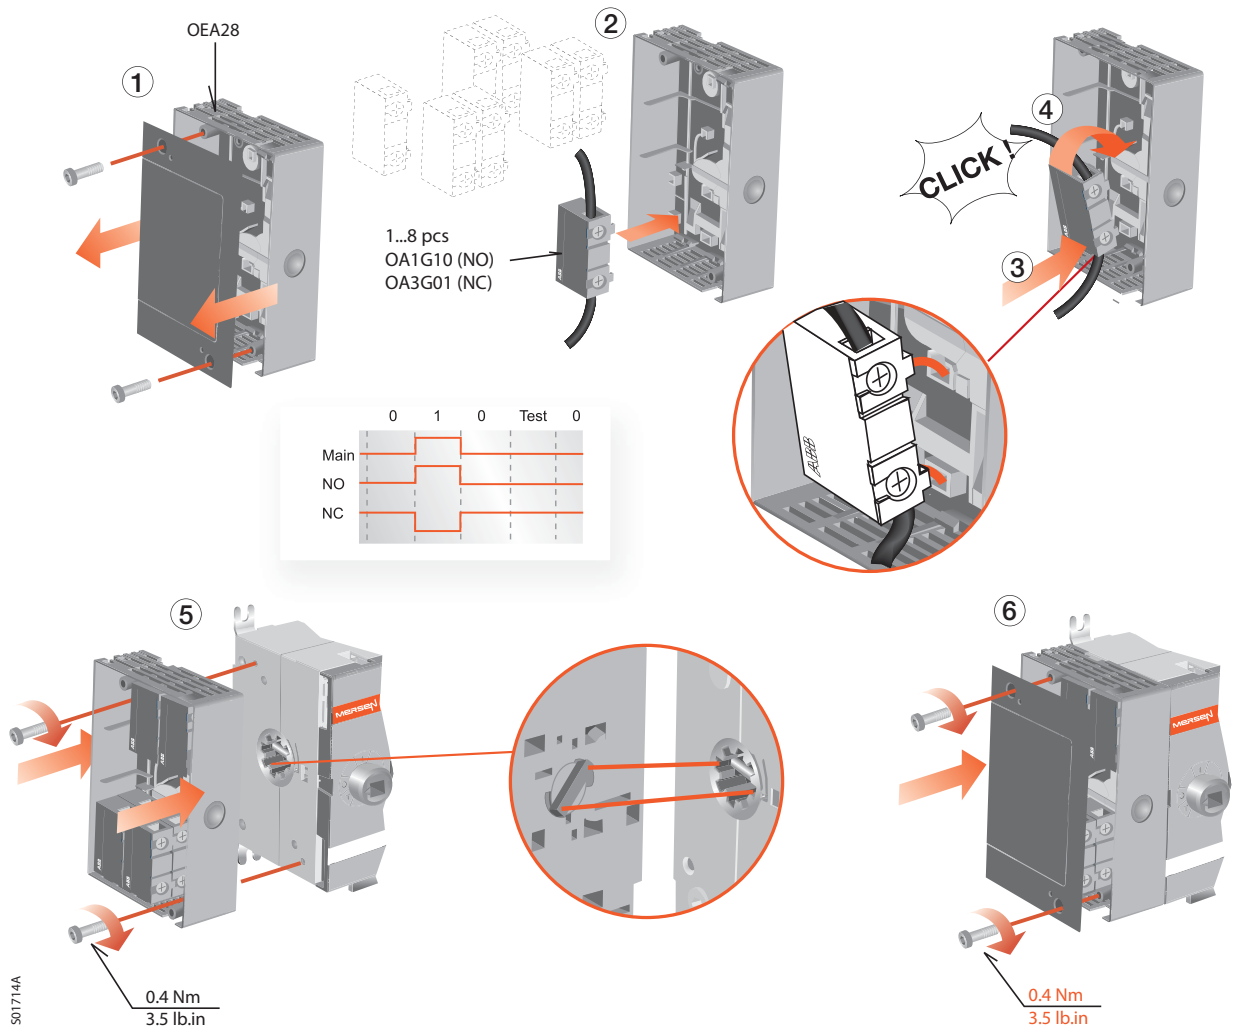


Fuse handling



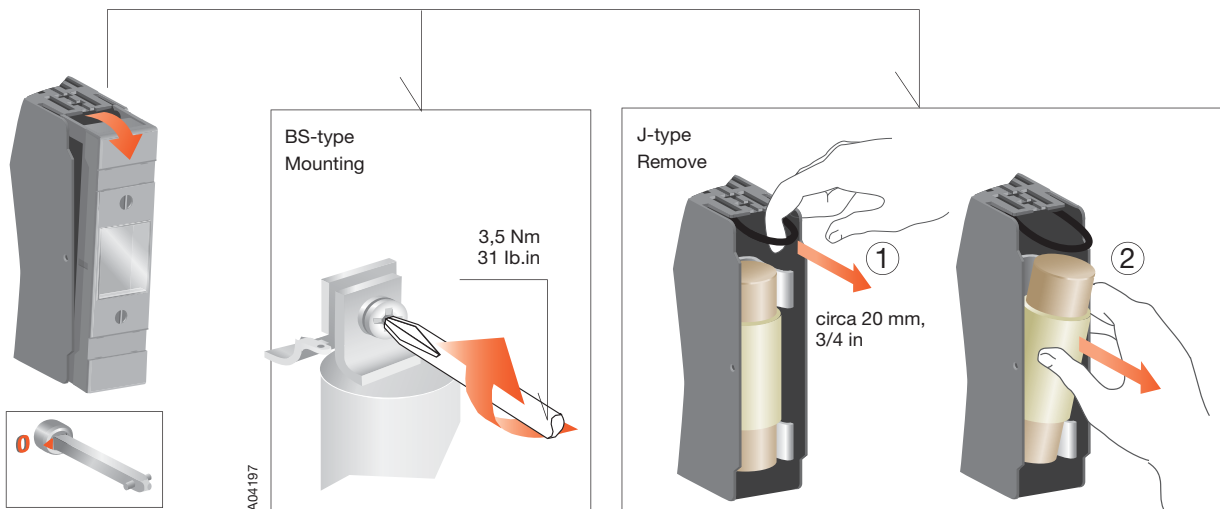


M30-63x Fused


HDFxxx

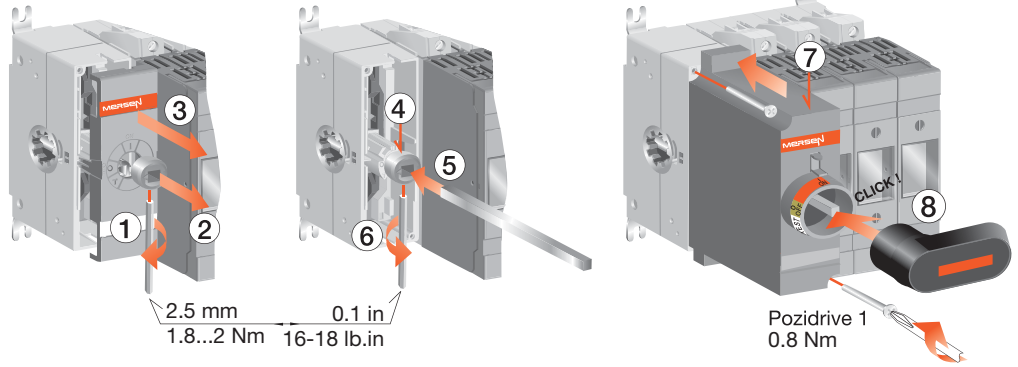







A04211

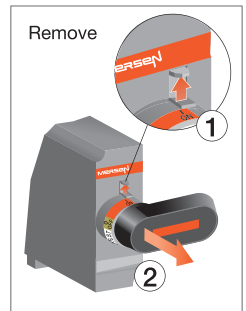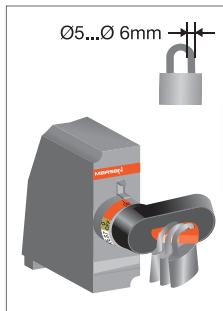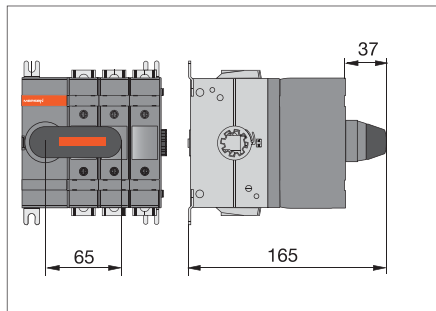

Internally-mounted Auxiliary Contacts

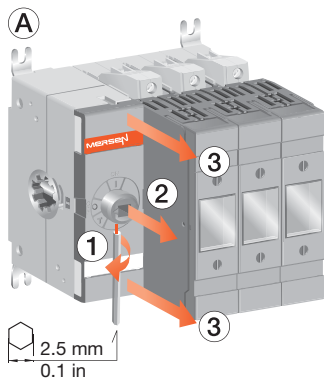


NO: OA1G10
NC: OA3G01

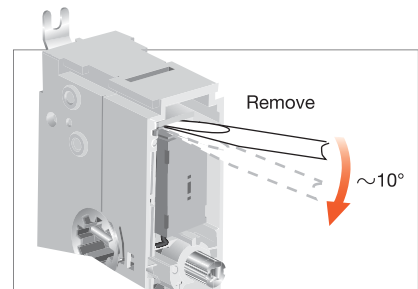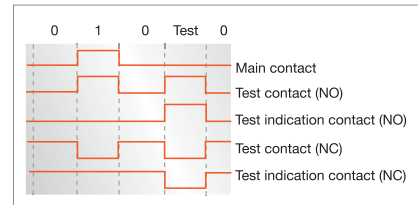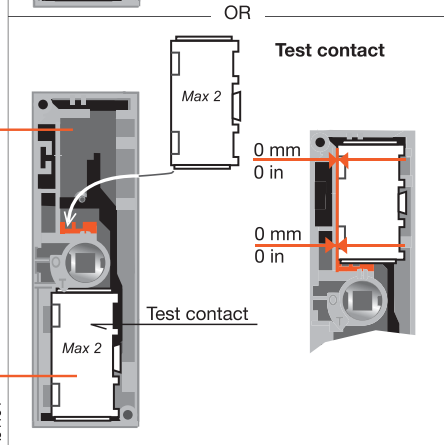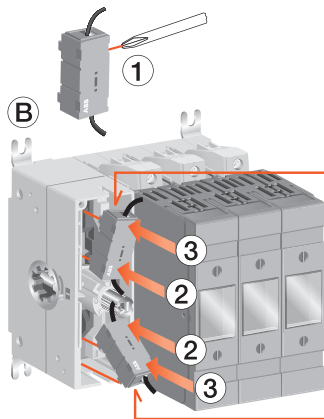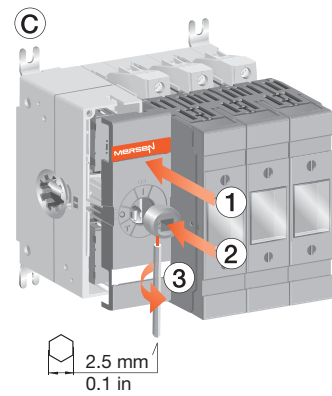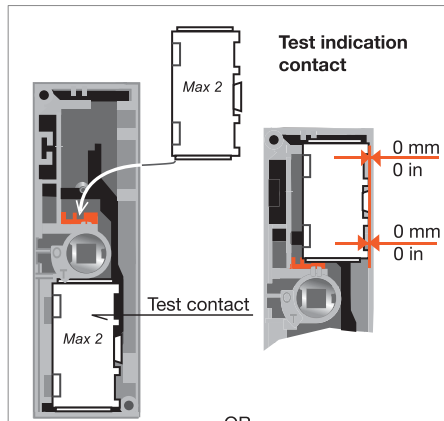






A04194

M30-63x Fused

Blown Fuse Indicators




A04276

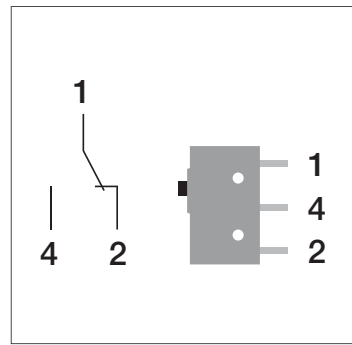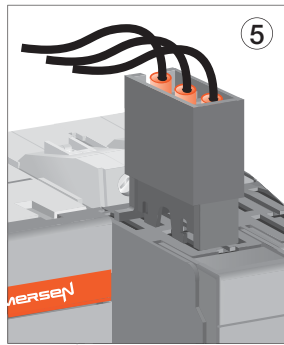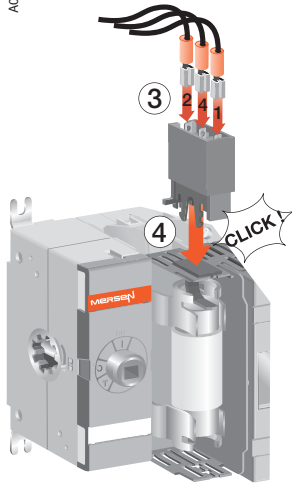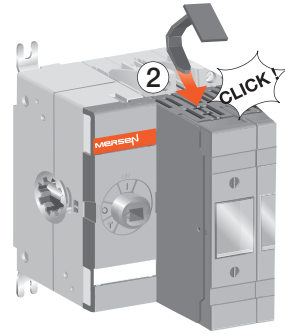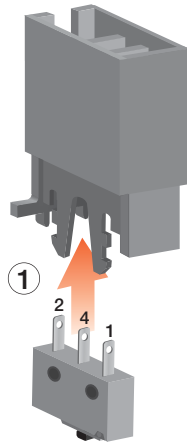





DIN-rail mounting kit

1 pole

2-4 pole

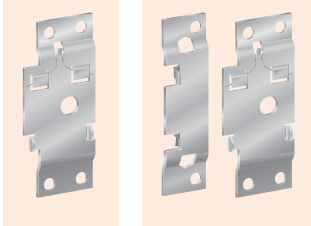

A04274

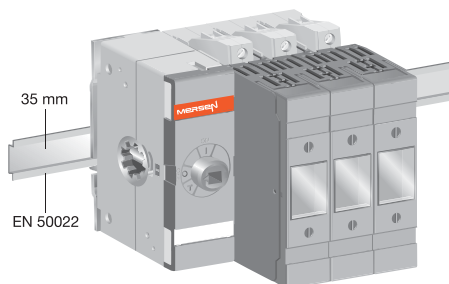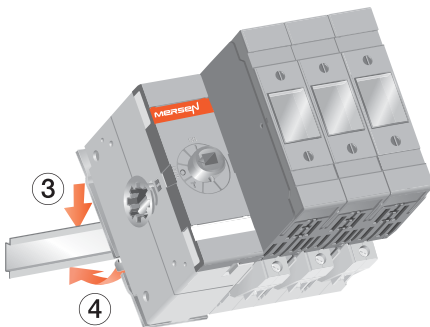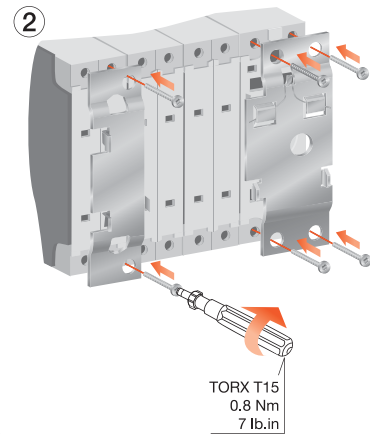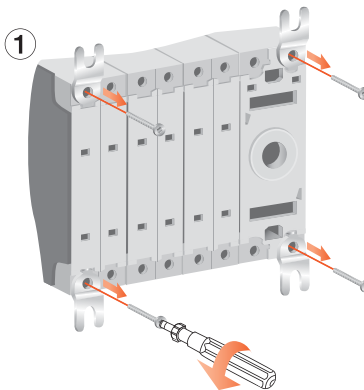



ep.mersen.com