


MEDIUM VLOTAGE AMP-TRAP FUSE
MINIMUM MELTING TIME CURRENT DATA
BOLT-IN 15.5KV
CAT. NO. A155B3DORO-300E

FERRAZ SHAWMUT
NEWBURYPORT, MA 01950

720663

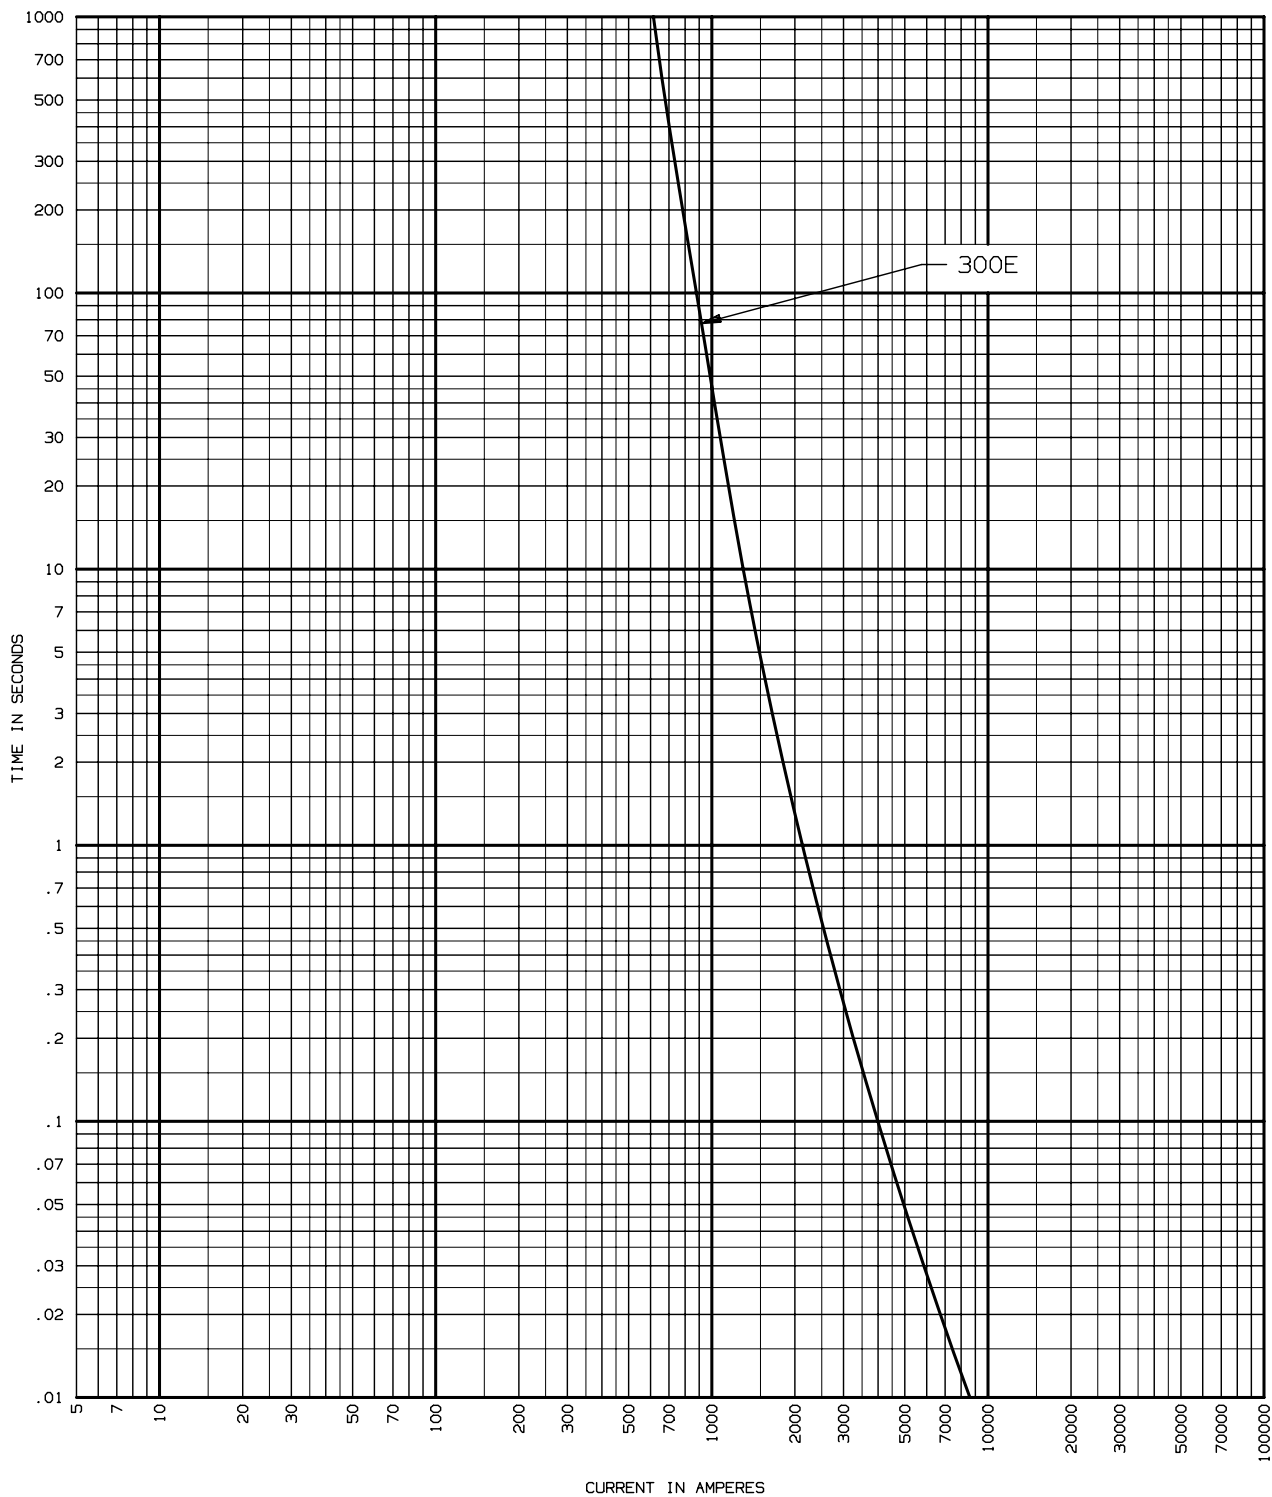

CONTROL NO.: 742
REV.: -
FOLDER NO.: 14A
3/18/05