CONTROL NUMBER: 197

REV. -
4/02/01

AMP-TRAP FUSE

A500T(1/4-5)E-1

1/4-5A 5000 VOLT

TOTAL CLEARING TIME-CURRENT DATA

FERRAZ SHAWMUT
NEWBURYPORT, MA 01950
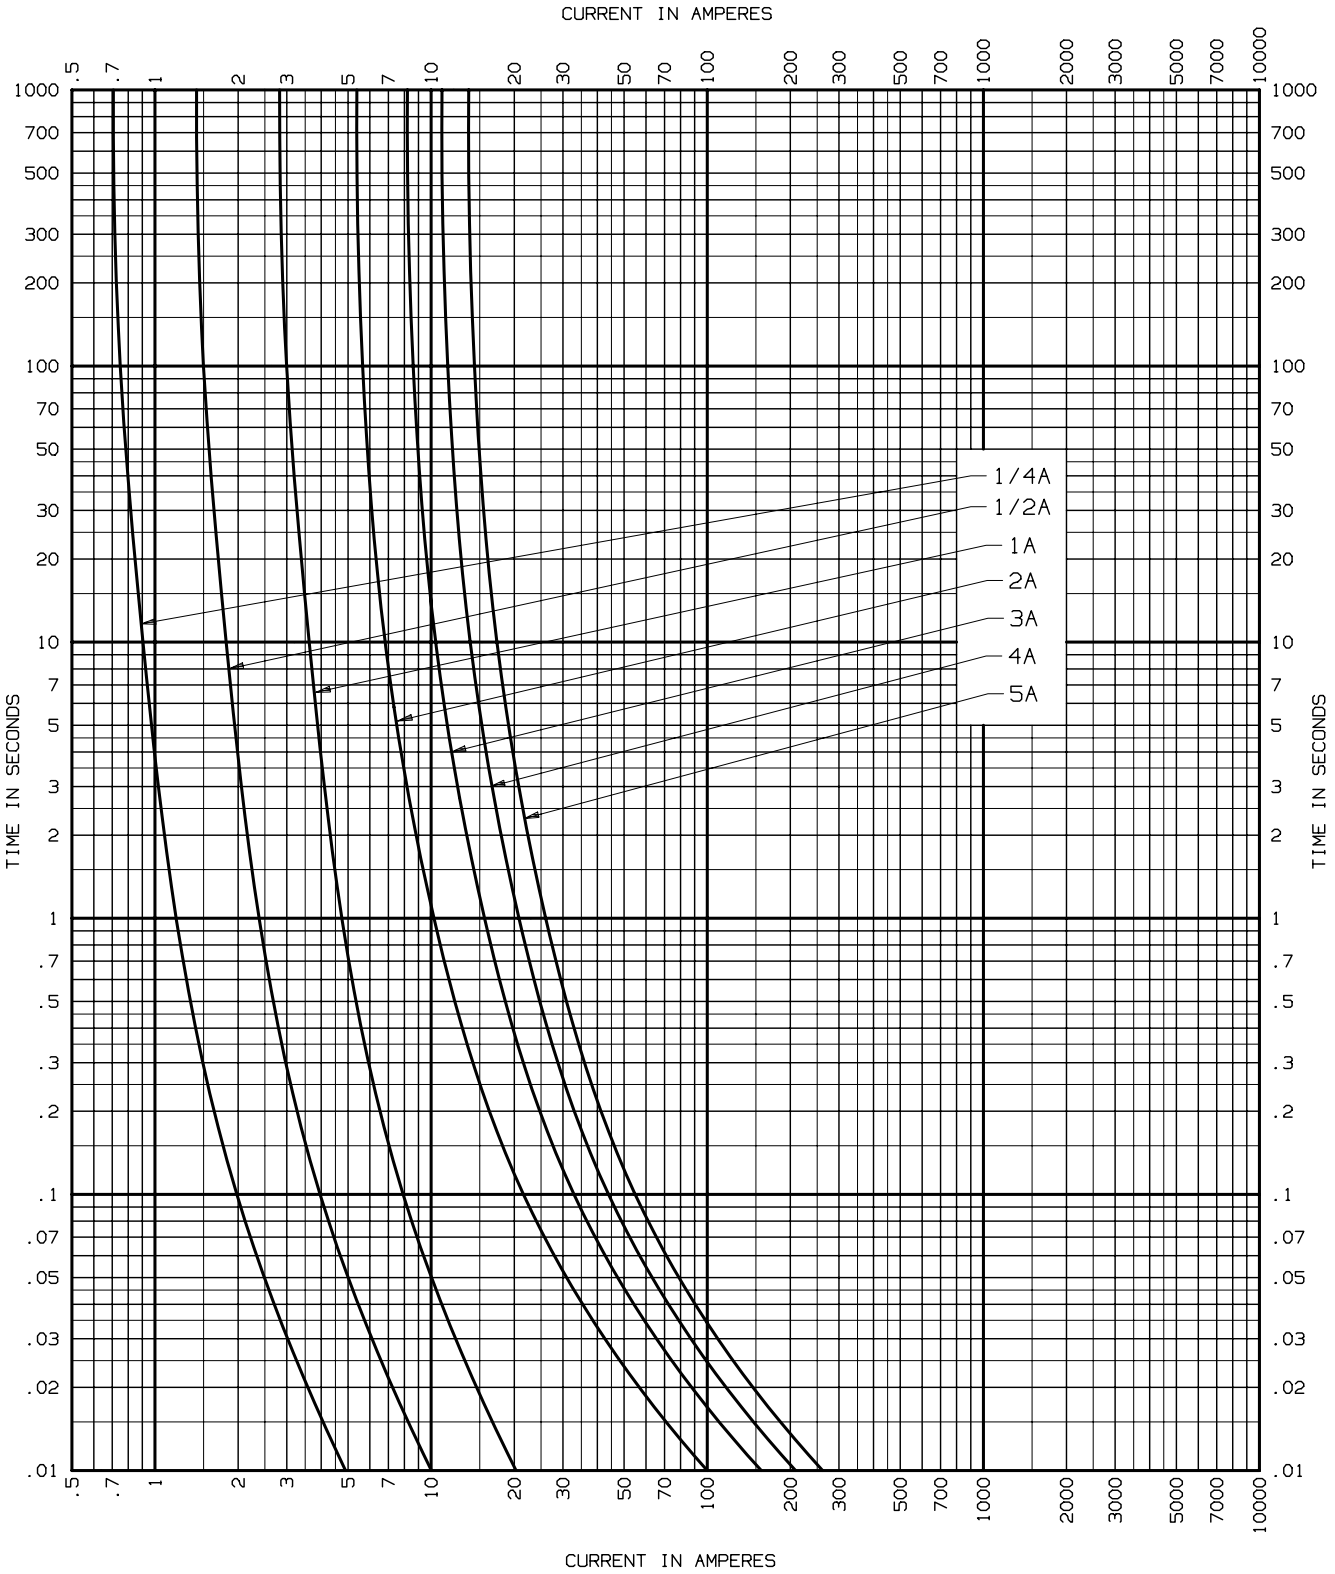
720327