


MEDIUM VOLTAGE AMP-TRAP FUSE  
 TOTAL CLEARING TIME CURRENT DATA  
 CS-3 5.5KV  
 CAT. NO. A055F1CORO-(5E-65E)  
 MERSEN USA NEWBURYPORT-MA, LLC  
 NEWBURYPORT, MA 01950

24437

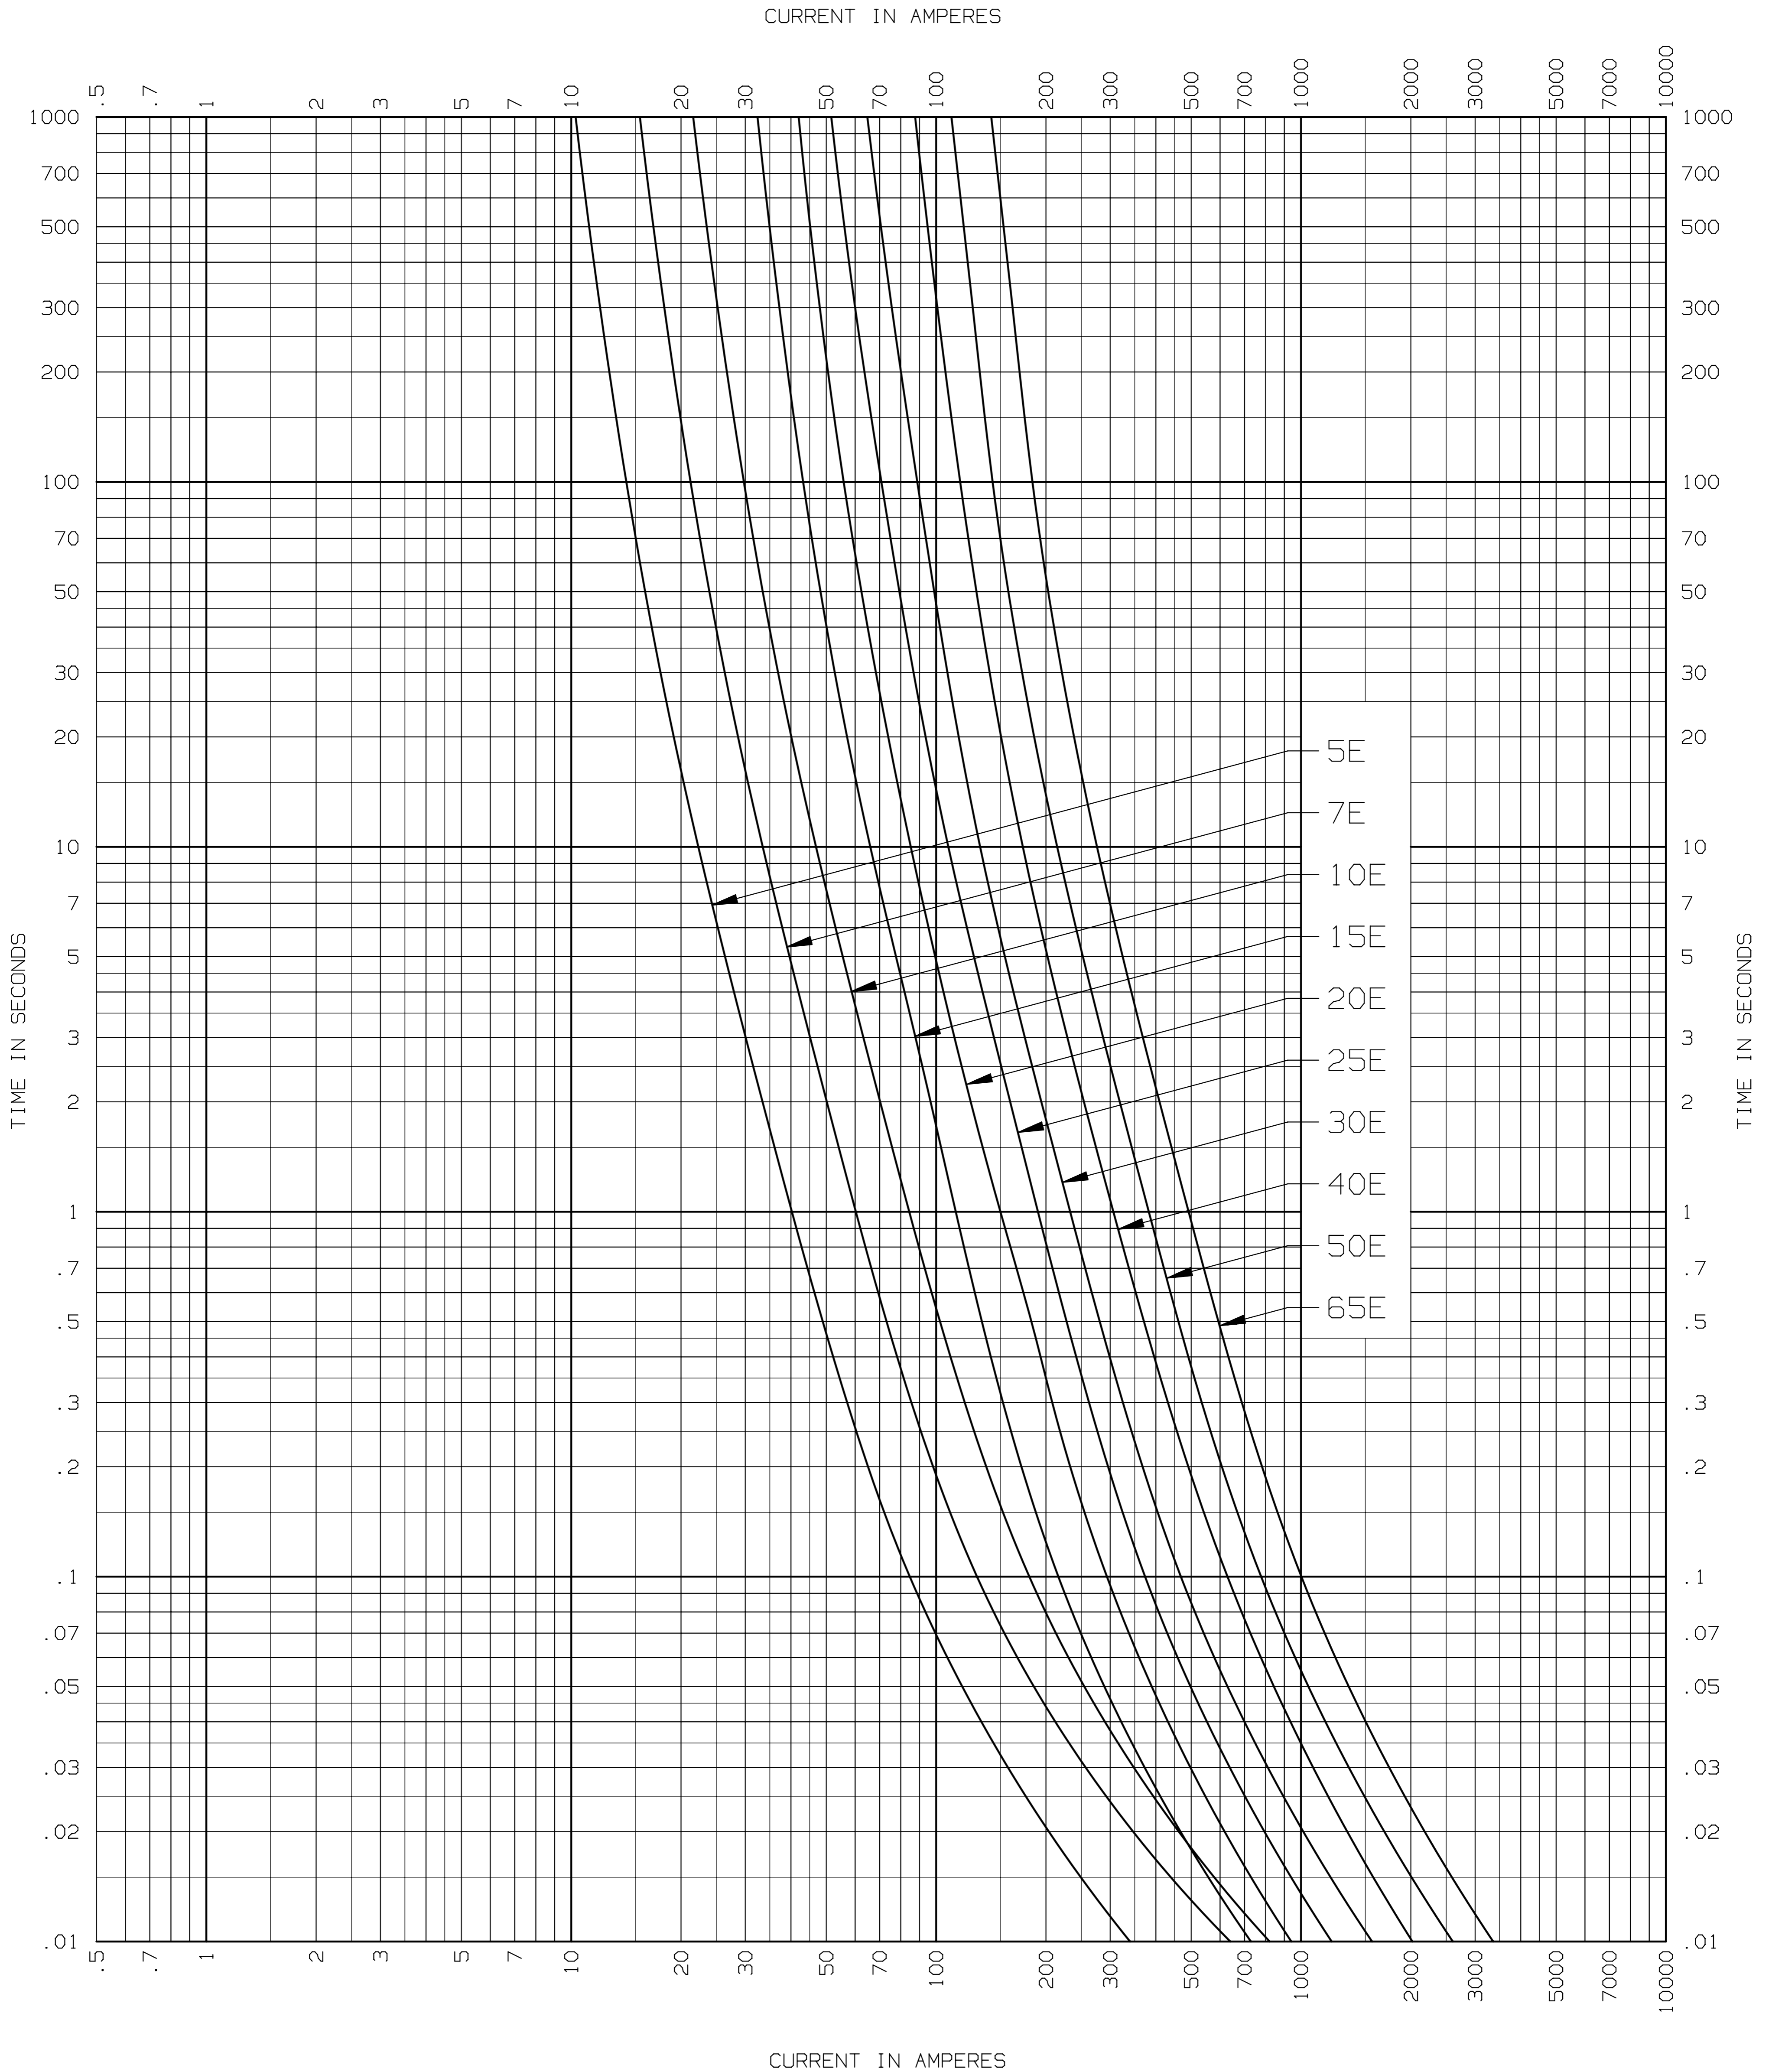

CONTROL NO.: 1340  
 REVISION: -  
 FOLDER NO.: 5B  
 DATE: 2-8-11