


MEDIUM VOLTAGE AMP-TRAP FUSE
MINIMUM MELTING TIME CURRENT DATA
BOLT IN 5.5KV

CAT. NO. A055B3DORO-(750E-900E)
A055B3DBRO-(750E-900E)



Newburyport, MA 01950

24445

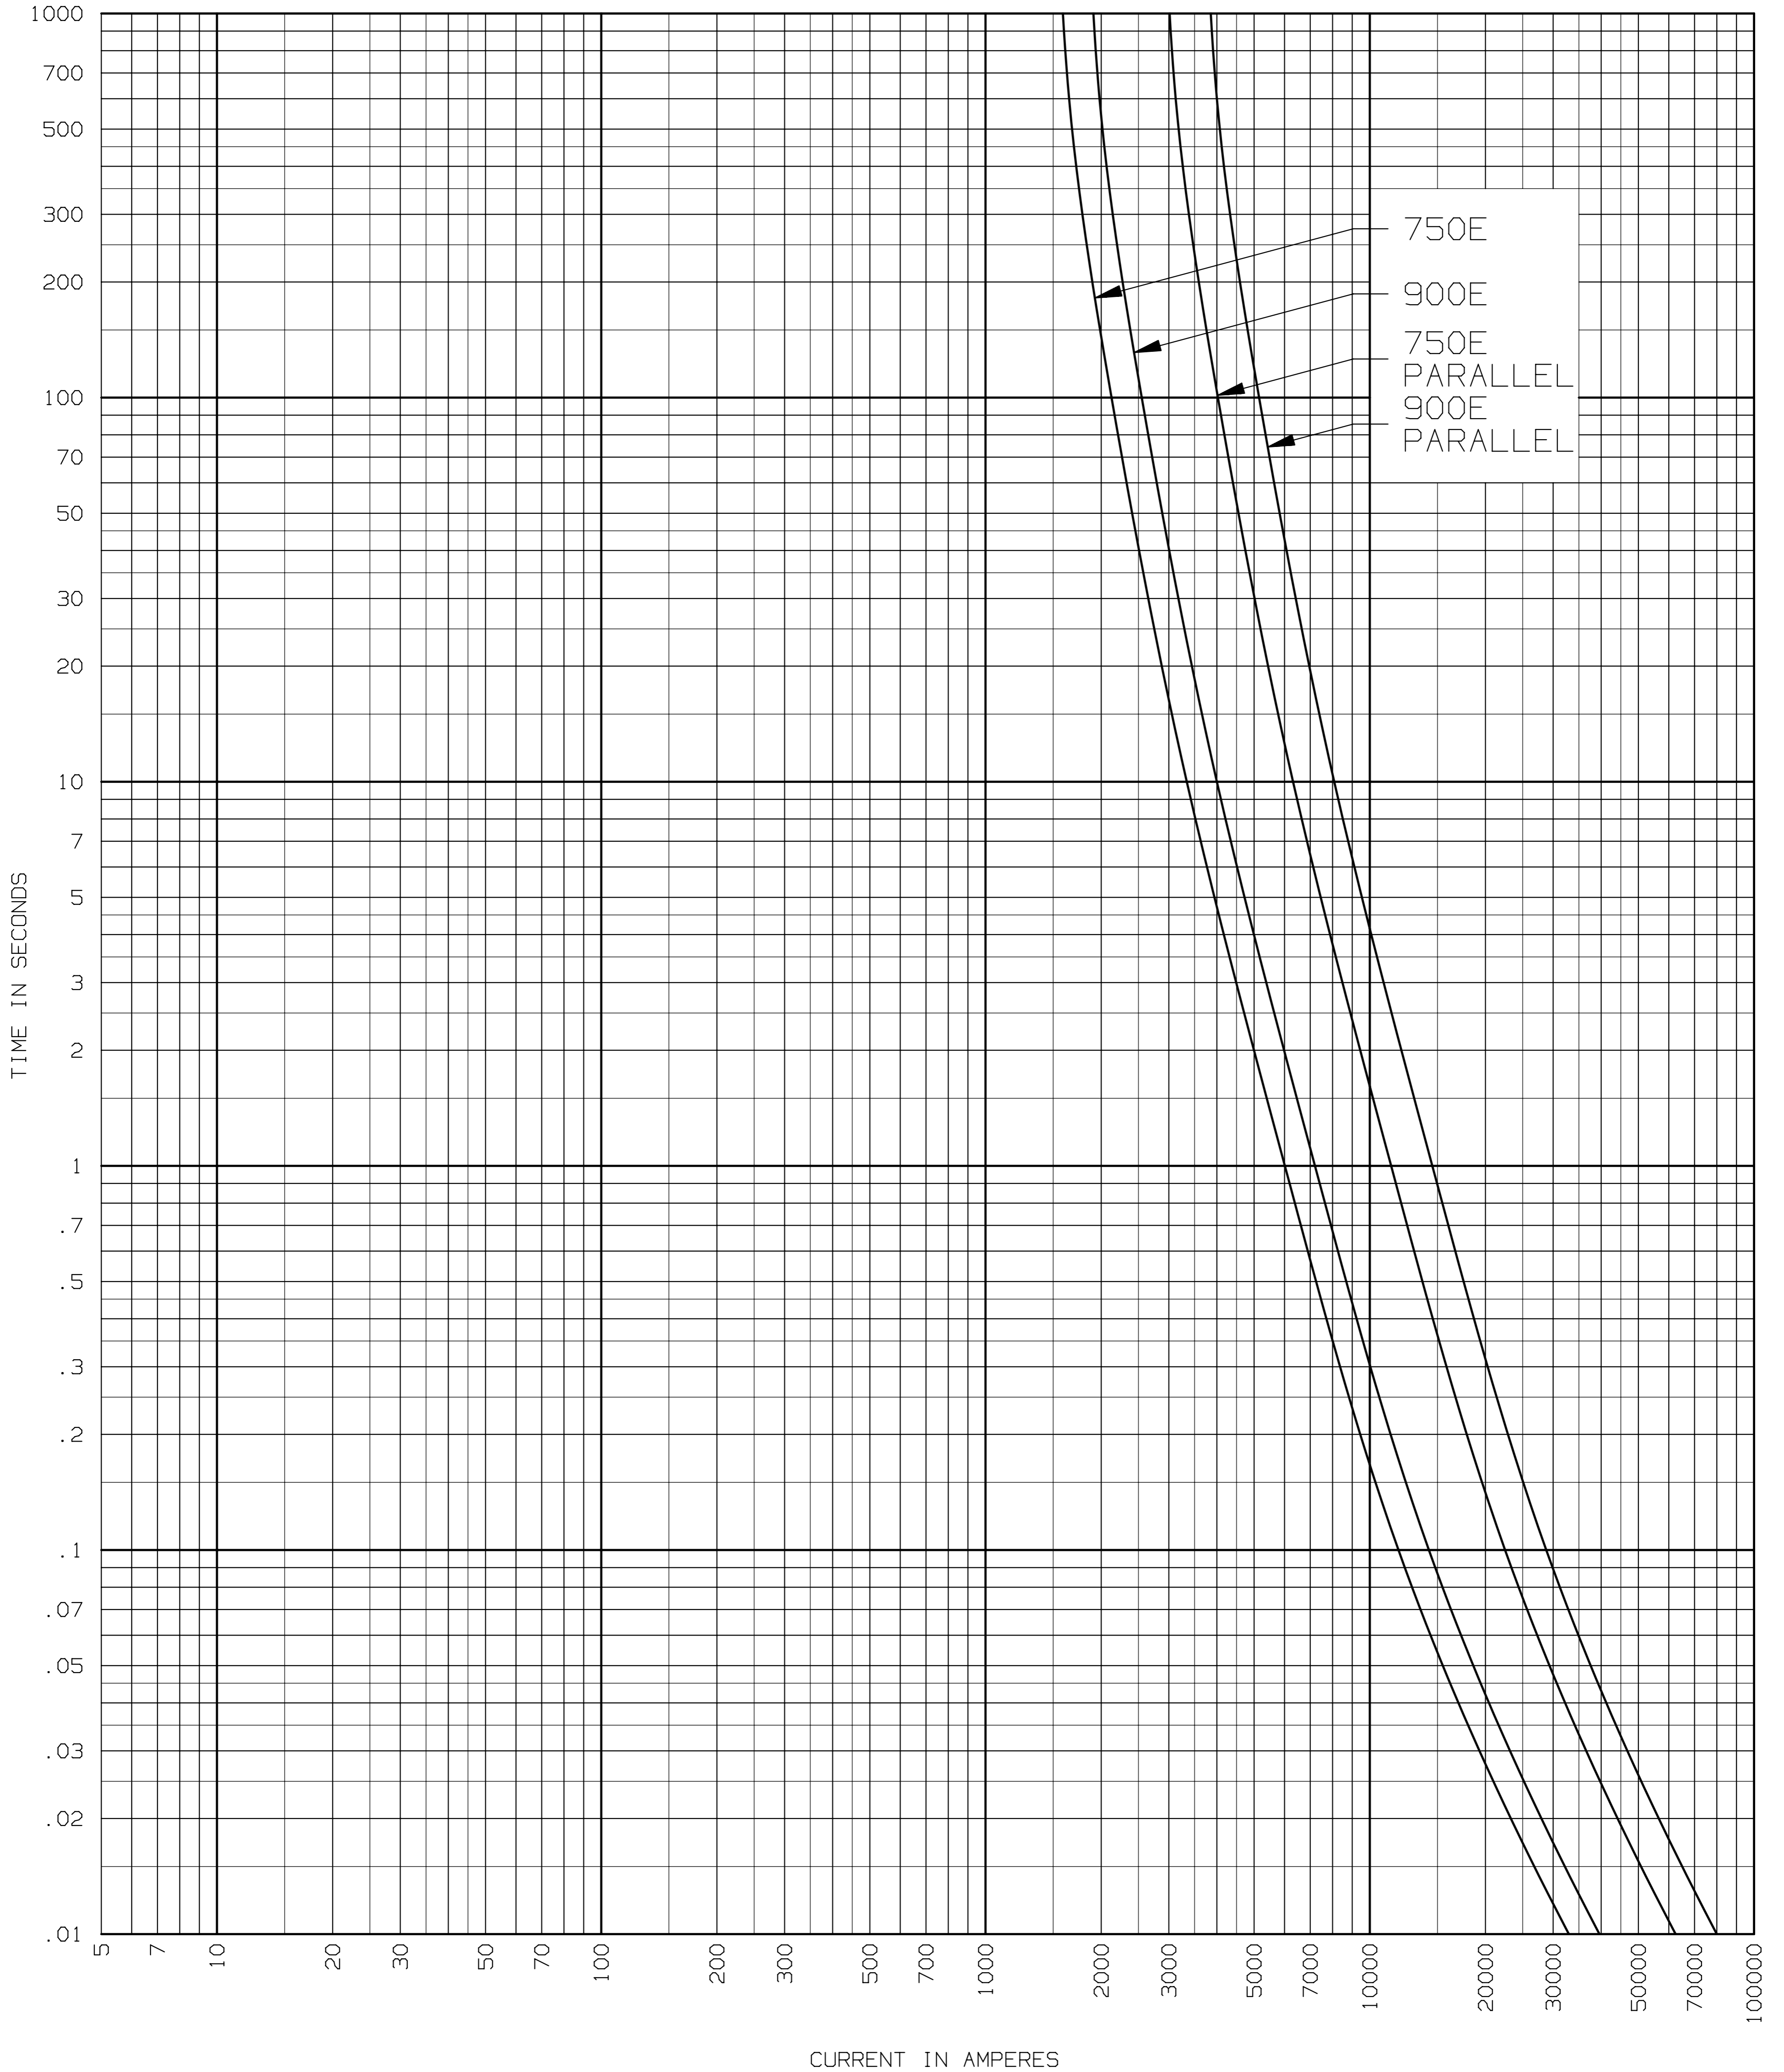

CONTROL NO: 729
FOLDER NO. 5B
REV. A
2/10/05