


TIME DELAY CLASS J FUSE
PEAK LET THRU CURRENT DATA
15-60 AMPS 600 VOLTS

AJT(8-60), AJT(5-60)N

MERSEN USA NEWBURYPORT-MA, LLC
NEWBURYPORT, MA 01950

25360

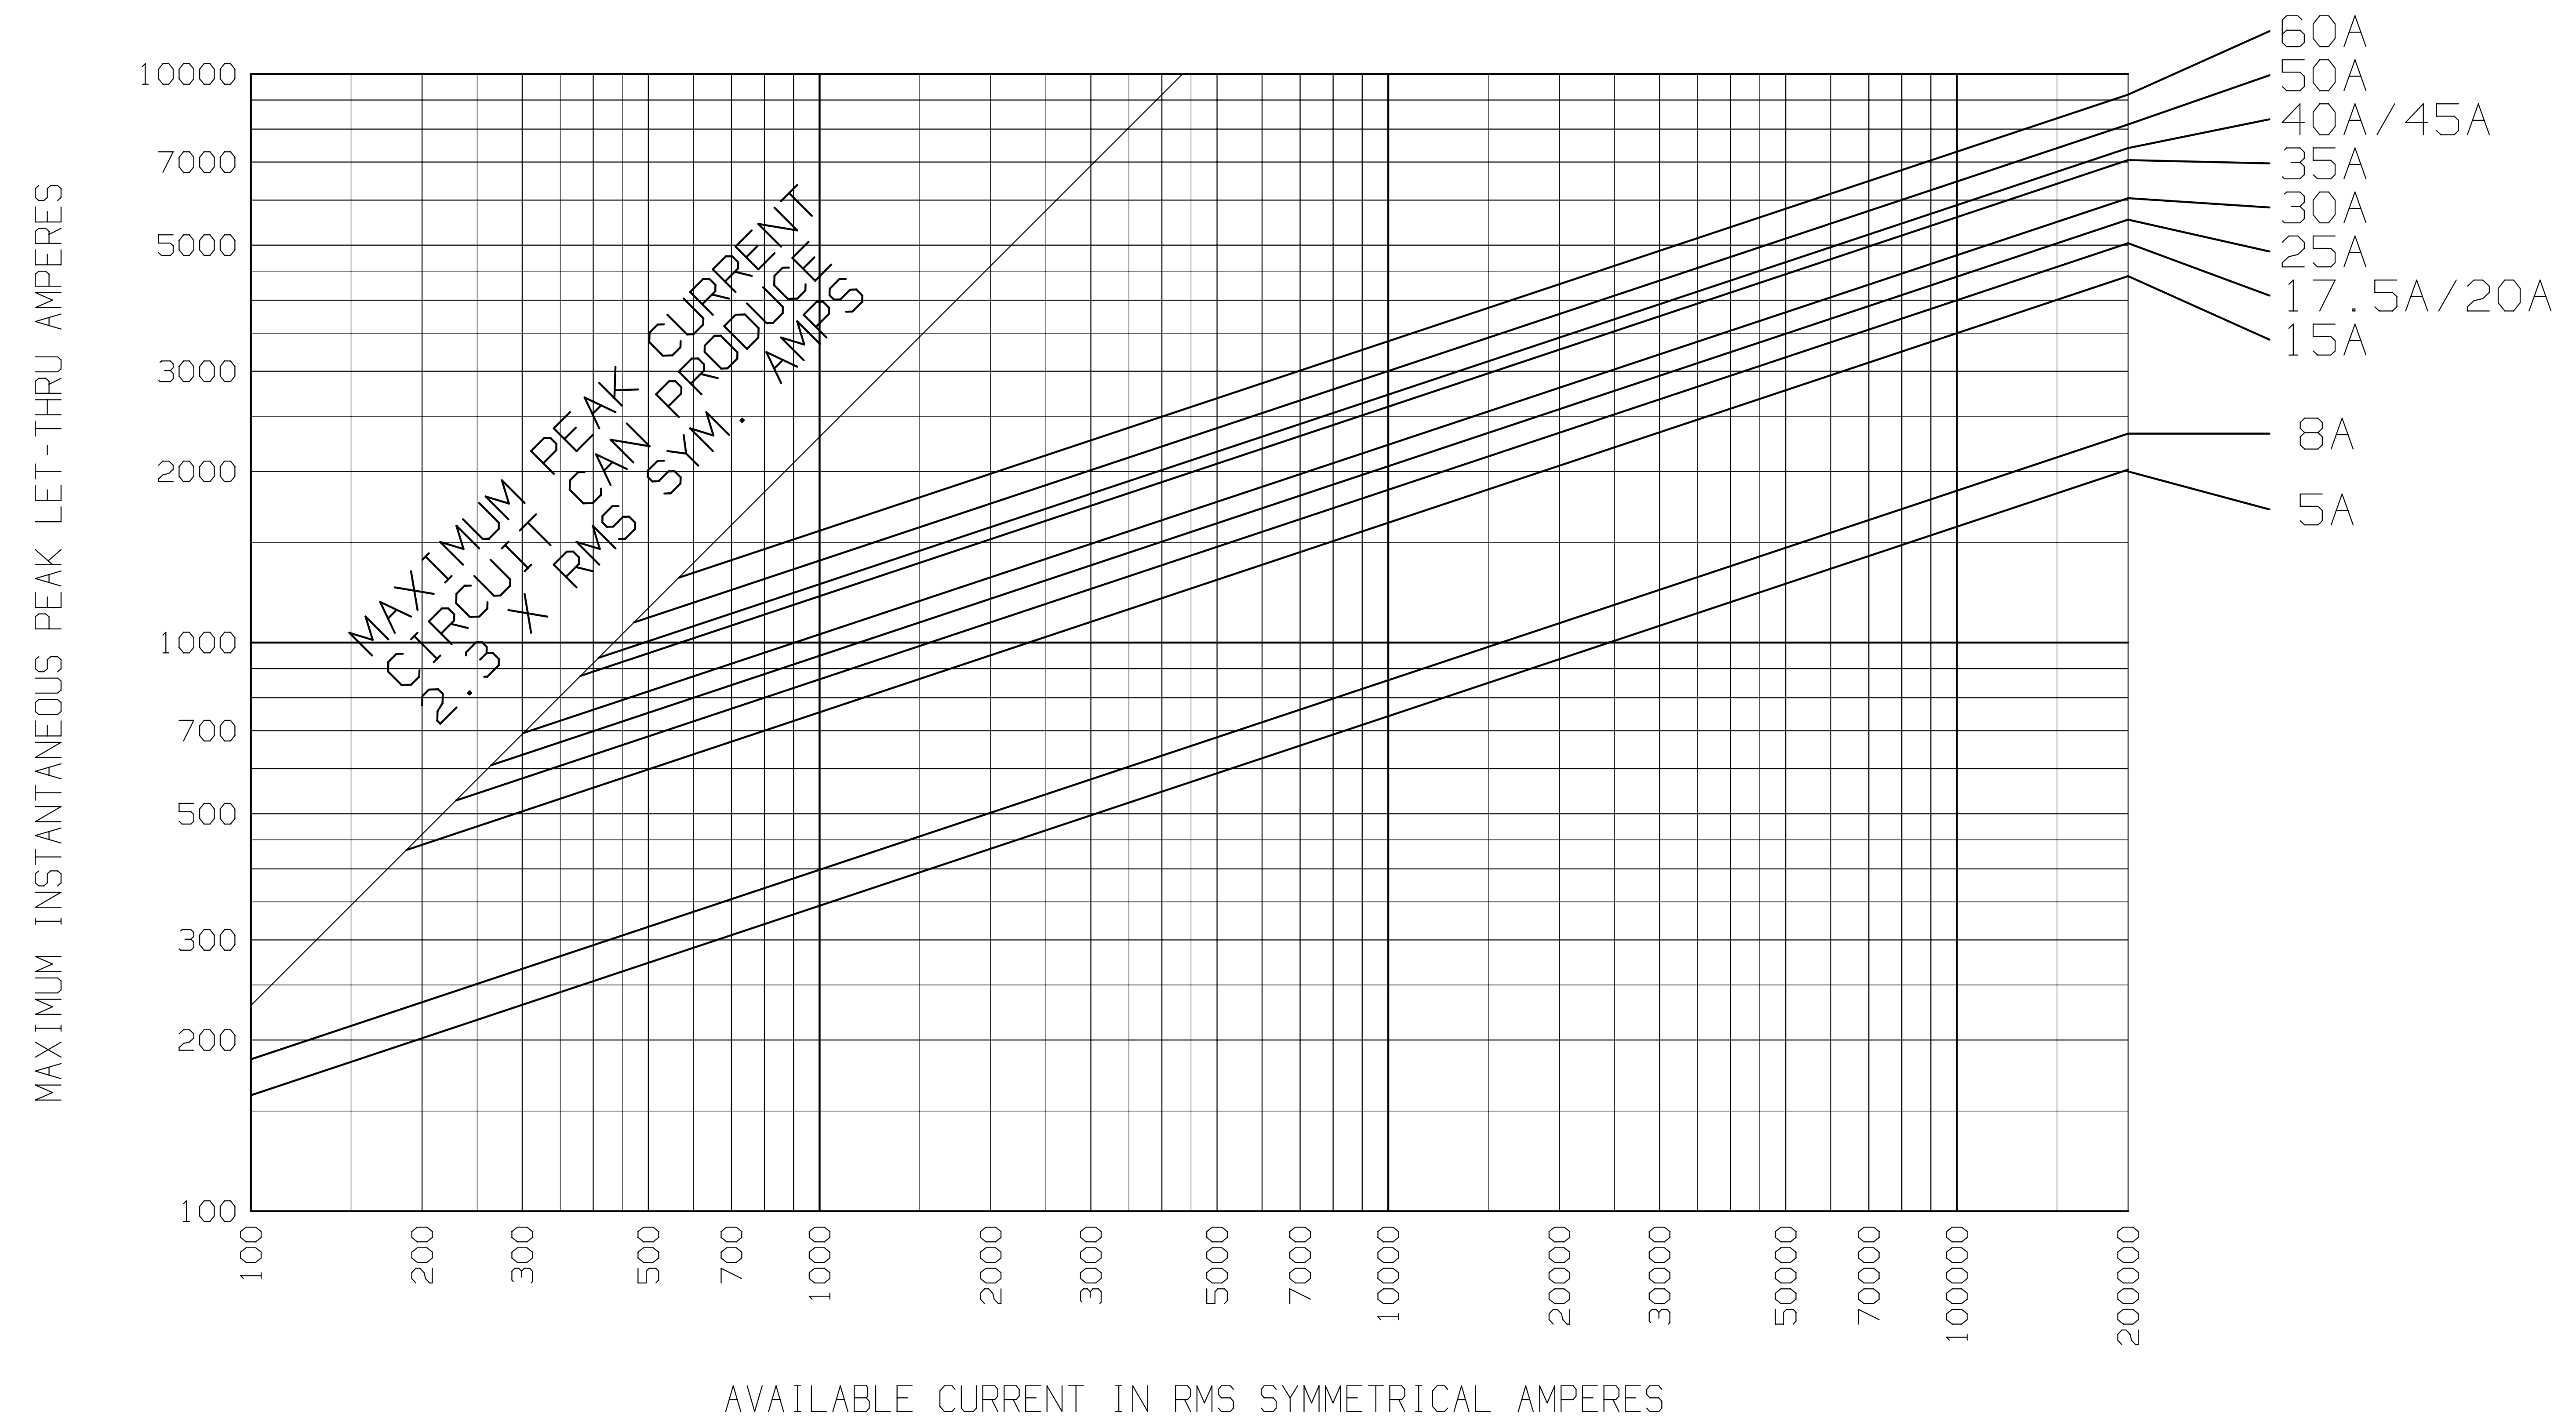

CONTROL NO: 2032
REV.: B
FOLDER: 13B
DATE: 1-25-19