MEDIUM VOLTAGE AMP-TRAP FUSE
A825X(E RATING) TYPE 1
CS-3
TOTAL CLEARING TIME CURRENT CURVE
10E-200E 8.25KV

MERSEN

Newburyport, MA 01950

270291

CONTROL NO: 175
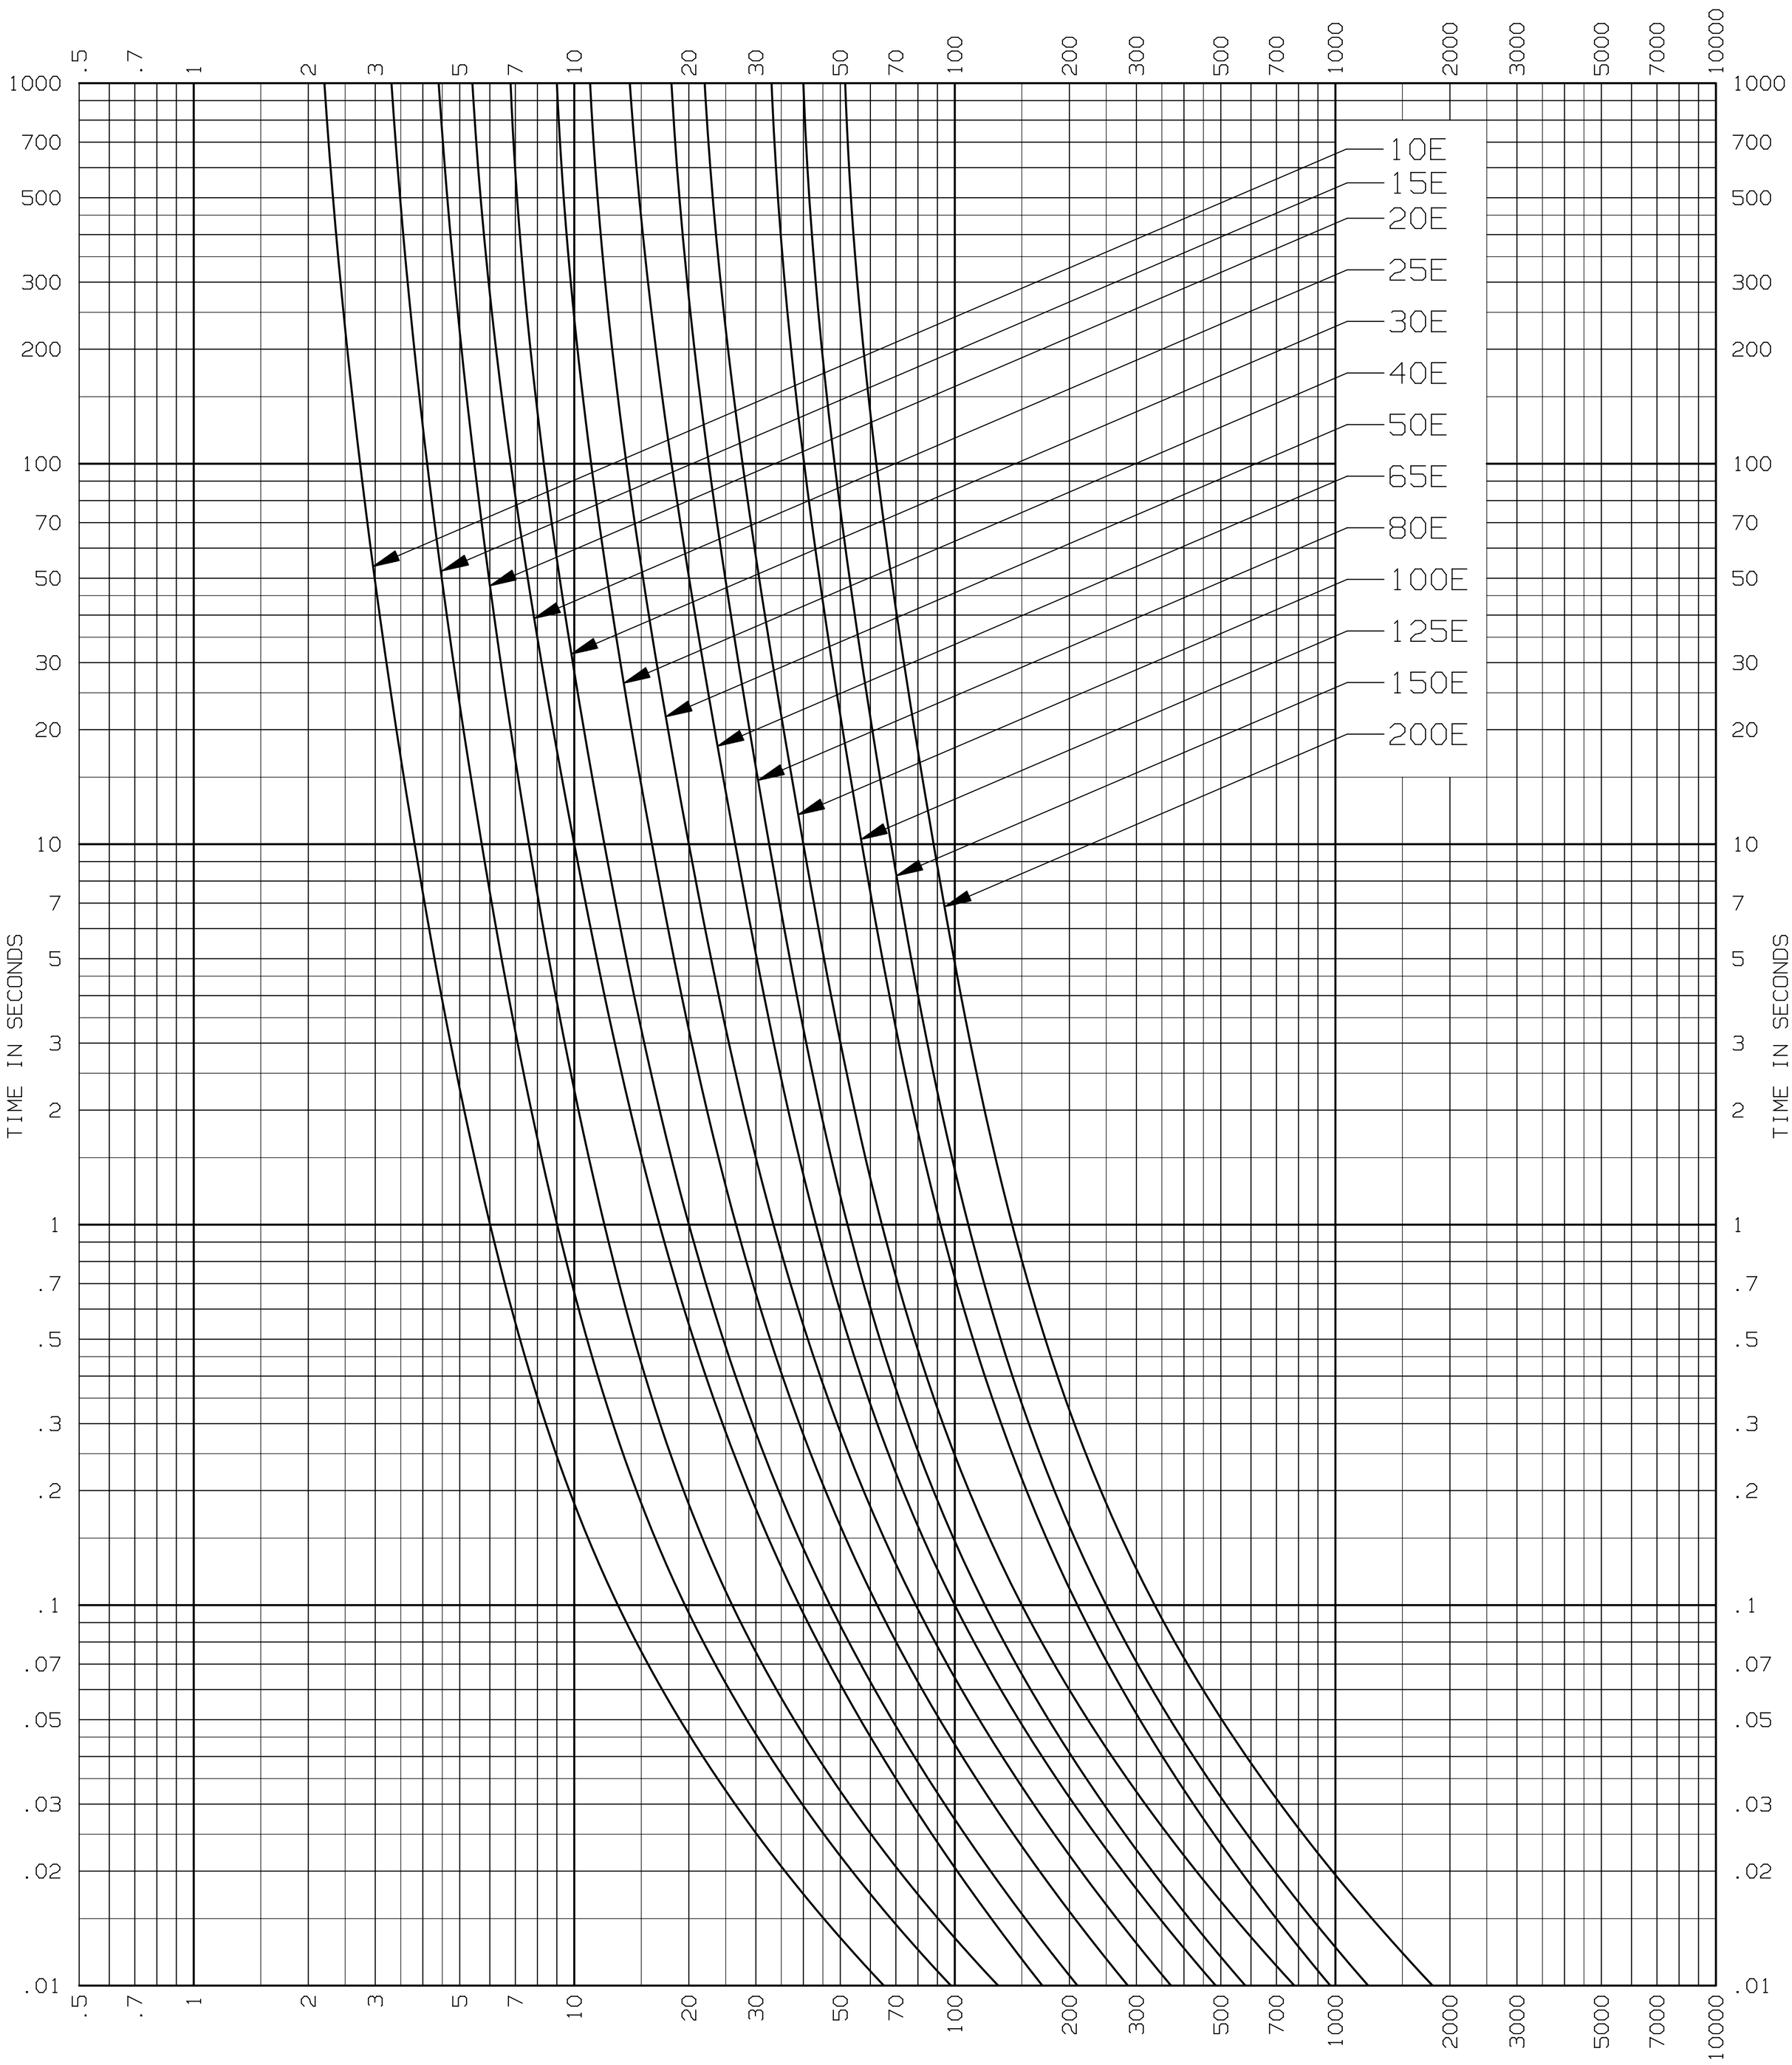
REV -
11/15/00