


MEDIUM VOLTAGE AMP-TRAP FUSE

A055B2DORO-(450-600)E
A055B2DCRO-(450-600)E

CS-3 5.5KV

PEAK LET THRU CURRENT DATA

MERSEN USA NEWBURYPORT-MA, LLC
374 MERRIMAC STREET
NEWBURYPORT, MA 01950
720457

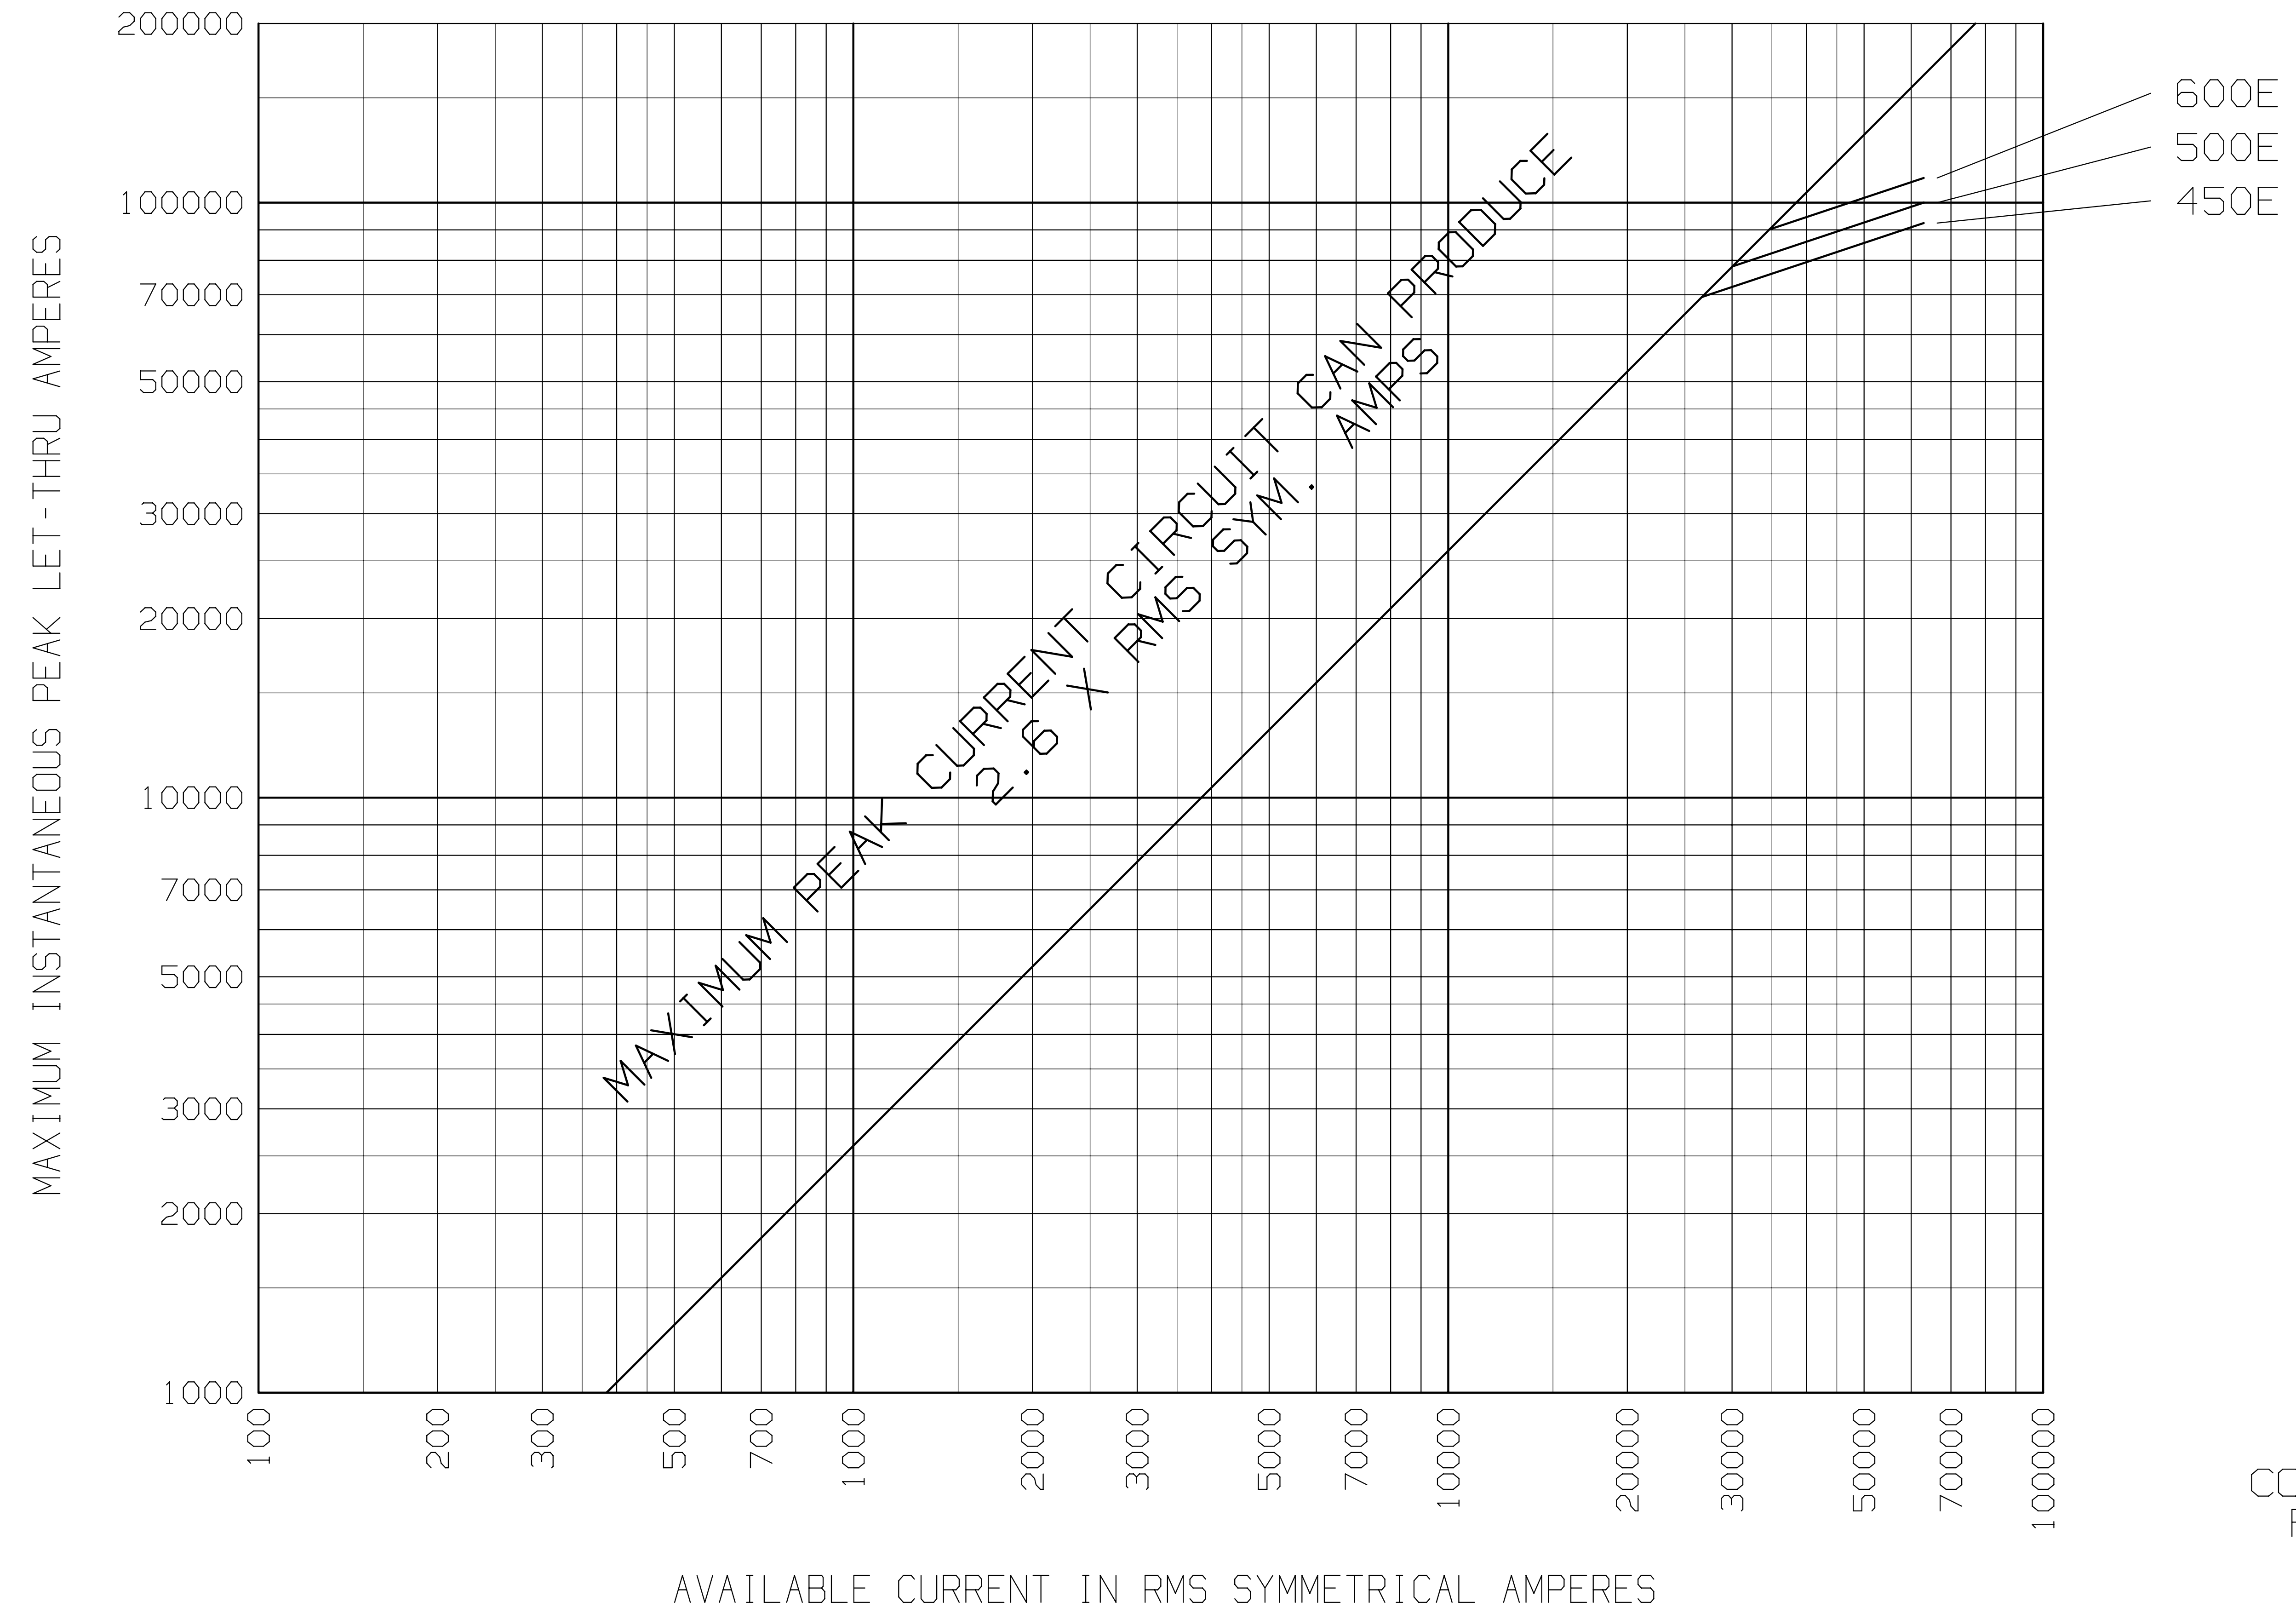

CONTROL NO. 1788
FOLDER NO. 5B
REV. A
5/16/16