


MEDIUM VOLTAGE AMP-TRAP FUSE
CL-14
A083C2DOR0-200E
200E 8.3KV
MINIMUM MELTING TIME CURRENT CURVE



Newburyport, MA 01950

720471

CURRENT IN AMPERES X10

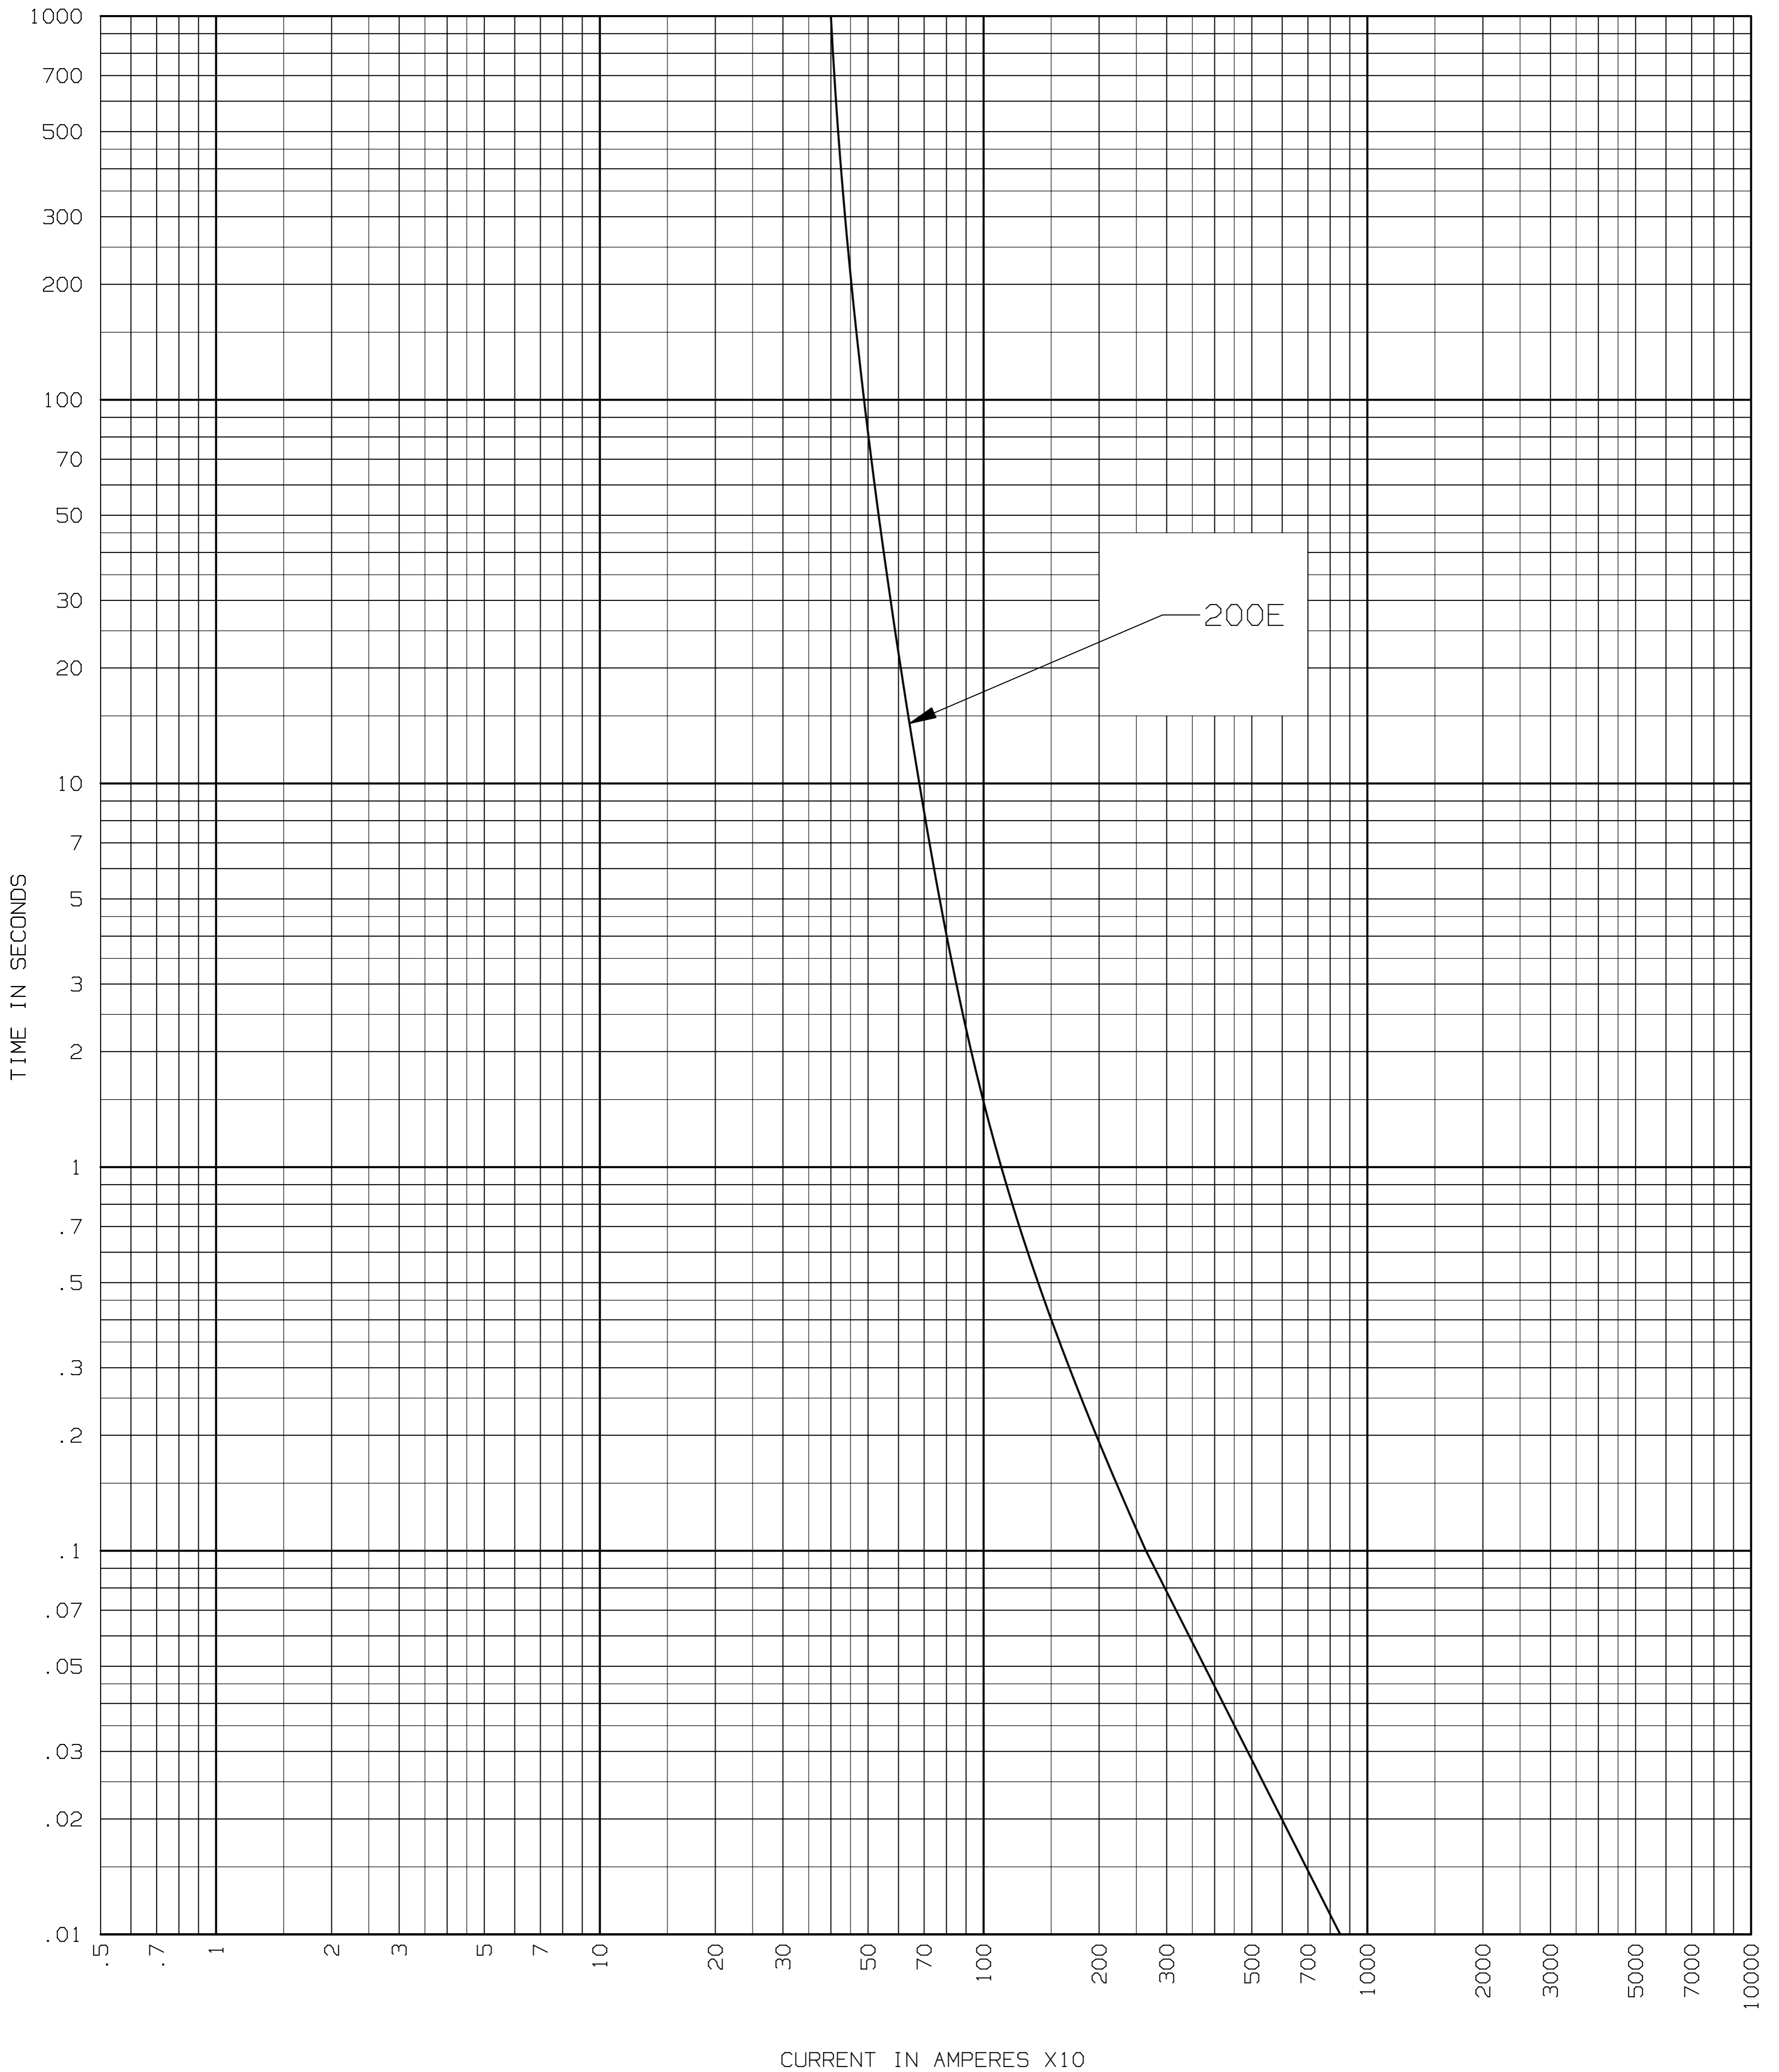

CURRENT IN AMPERES X10

CONTROL No: 1802
FOLDER NO.: 14A
REV. B
6-17-16