MEDIUM VOLTAGE AMP-TRAP FUSE

CONTROL NO: 730
FOLDER NO. 50
REV. E
2/10/05

CAT. NO. A051B1DAR0-19R
A051B2DAR0-32R
A051B2DAR0-38R
A051B3DAR0-48X
A051B3DAR0-57X
19R & 38R 5.5KV MAX
48X & 57X 5.2KV MAX

TOTAL CLEARING TIME-CURRENT CURVE

FERRAZ SHAWMUT
NEWBURYPORT, MA 01950
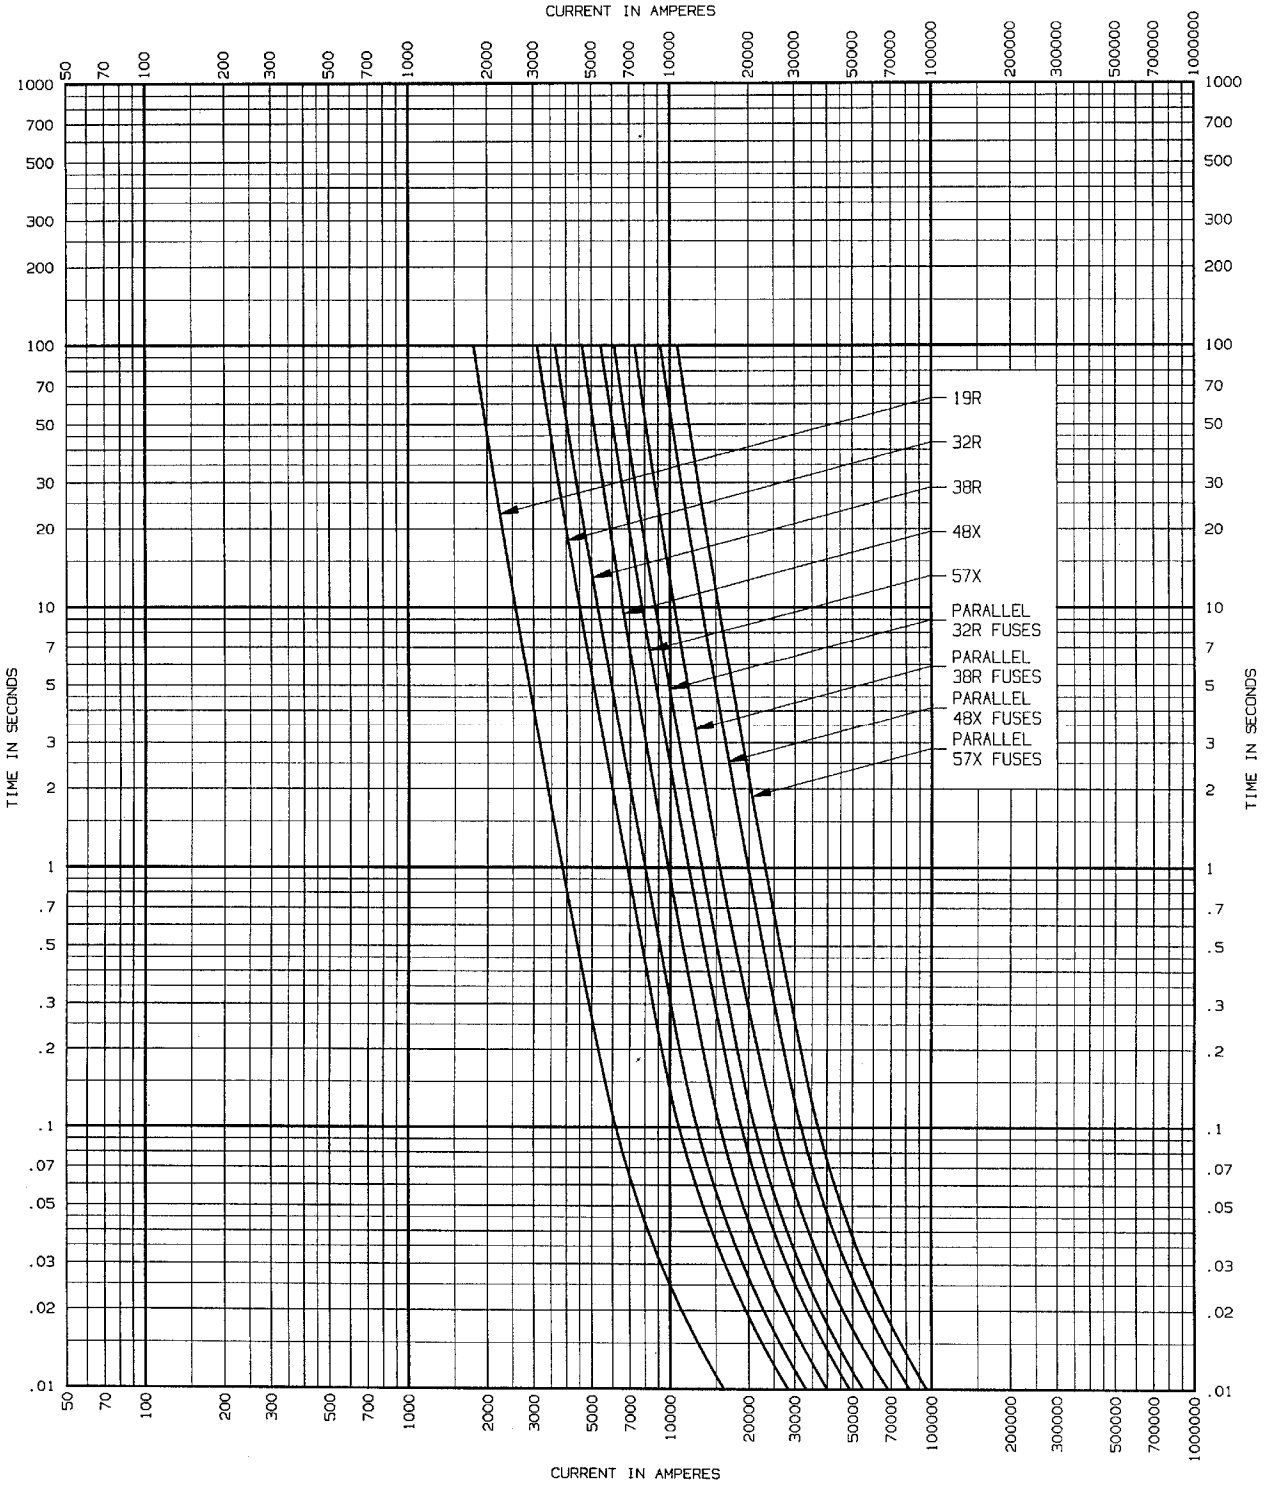
102656