
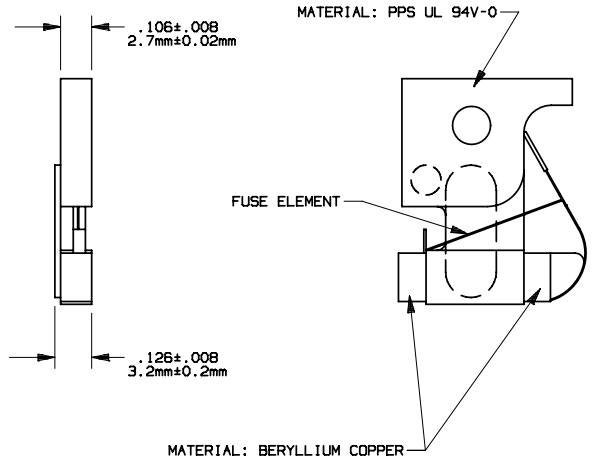


REV	DATE	ECO	DESCRIPTION	BY	CHK	APP
-----	------	-----	-------------	----	-----	-----

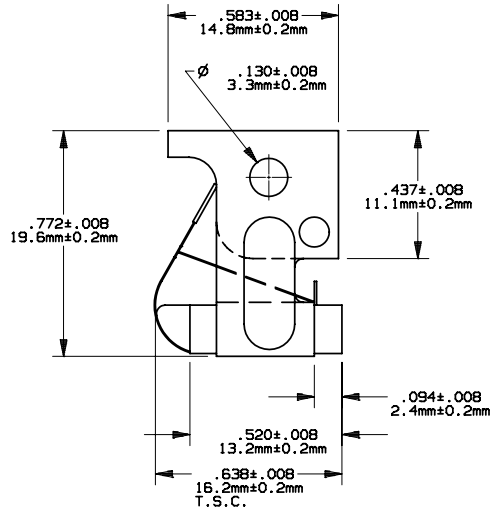

% OF RATED CURRENT	100% IN	150% IN
	CLEARING TIME	
RATED IN	Min.	Max.
0.5A-15	600 SEC	300 SEC

BREAKING CAPACITY (RATED INTERRUPTING CURRENT): AC/DC 125V, 300A/ DC 60V, 450A

	MERSEN USA NEWBURYPORT-MA, LLC 374 MERRIMAC STREET NEWBURYPORT, MA 01950	
	PRODUCT MANAGER	DESIGN ENGINEER
SIGN:	SIGN:	
DATE:	DATE:	

GMS(1/2-15)  
 TELECOM FUSE  
 125V AC/DC 1/2A-15A

OUTLINE DIMENSIONS  
 NOT TO BE USED FOR PRODUCTION  
 701177